

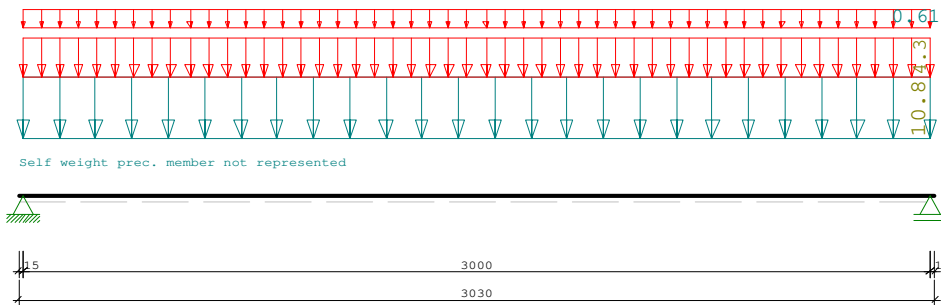


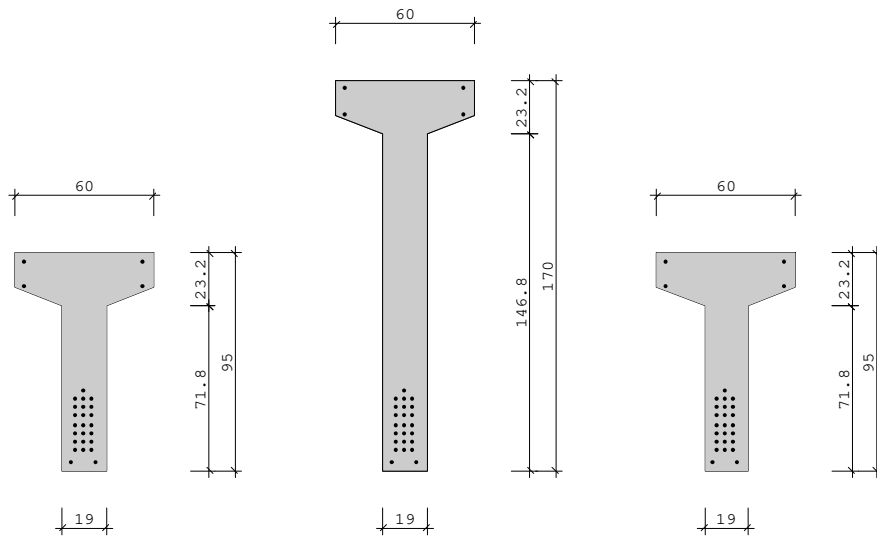

**Item: B8\_FDB-Ref-BS**

Prestressed Concrete Girder B8 01/2022 (Frilo R-2022-1/P07)

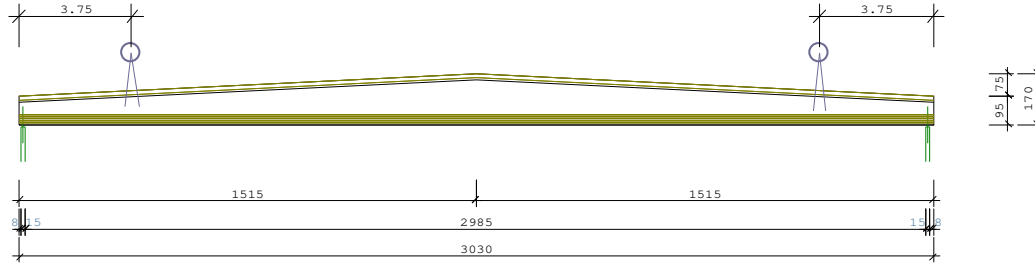

**System:**

Double-pitch roof

Basics:

Load combinatorics: NA to BS EN 1990/A1:2009-06 + EN 1990:2002/AC:2010  
 ULS: Structural safety checks(STR)  
 permanent/variable design situation with equation 6.10 a,b

Design code: NA to BS EN 1992-1-1/A2:2015-07 + EN 1992-1-1:2004 /AC:2010  
 Prestressing for pretensioning with heat treatment in stressing mould



**System Geometry:**

Total L = 30.30 m Effective L1 = 30.00 m  
 Outstand left L0 = 0.15 m right L2 = 0.15 m  
 Distance Ridge L3 = 15.15 m  
 Height beam :  
 left H1 = 95.0 cm Ridge H2 = 170.0 cm  
 right H3 = 95.0 cm  
 Relation eff.span to height of beam:  
 L1/H2 = 17.65

Erection attachment, distance from the beginning resp. end of beam:  
 Hook L8 = 3.75 m right L9 = 3.75 m

**Cross-section Precast :**

Layer of cross-section from top to bottom				
Nr	Width [cm]	Distance [cm]	Remarks	
1	60.0	0.0		
2	60.0	15.0		
3	19.0	23.2	Web begin	
4	19.0	170.0	Web end	
Top flange height over beam length constant				

**Material:**

**Prestressing steel**

Y1770S7 Strand 7 wires

$d_d = 4.1$  mm  $d_p = 12.3$  mm  
 $E_p = 195000$  N/mm<sup>2</sup>  $A_p = 0.930$  cm<sup>2</sup>  
 $f_{p0.1k} = 1520$  N/mm<sup>2</sup>  $f_{pk} = 1770$  N/mm<sup>2</sup>  
 $\epsilon_{uk} = 35.0$  ‰  $\epsilon_{ud} = 31.5$  ‰

Partial safety factor :  
 $\gamma_s = 1.15$

Coeff. prestress:

charact. value  $r_{sup} = 1.00$   $r_{inf} = 1.00$   
 Design value  $\gamma_{p,max} = 1.10$   $\gamma_{p,min} = 0.90$

Proof of crack width

Equ. diameter  $d_{pv} = 7.20$  mm  $\xi = 0.60$  (Tab. 6.2)

Relaxation class 2 (strands, wires, low relaxation)					
$\sigma_{p0}/f_{pk}$	10 h	200 h	1000 h	500000h	
0.60	0.1	0.2	0.4	2.5	
0.70	0.3	0.7	1.0	3.9	
0.80	1.2	1.9	2.4	6.1	
- Losses in % by 3.3.2 (6), example process					

Permitted stresses:

in formwork  $\sigma_p \leq 1368.0$  N/mm<sup>2</sup> (0.90\*  $f_{p0.1k}$ )  
 after anchor. release  $\sigma_p \leq 1292.0$  N/mm<sup>2</sup> (0.85\*  $f_{p0.1k}$ )  
 char. Lc  $\sigma_p \leq 1327.5$  N/mm<sup>2</sup> (0.75\*  $f_{p0.1k}$ )

Transmission length

$\eta_{p1} = 3.20$   $\eta_1 = 1.00$   
 $\alpha_1 = 1.25$   $\alpha_2 = 0.19$   
 $\sigma_{pm0} = 882$  N/mm<sup>2</sup>  
 PT:  $f_{ctdt} = 0.81$  N/mm<sup>2</sup>  $f_{bpt} = 2.58$  N/mm<sup>2</sup>  
 $l_{pt} = 1.00$  m

Dispersion\_length:

$d = 0.91$  m  $l_{disp} = 1.35$  m



**Reinforcing steel:**

Longitudinal B 500B		Stirrup B 500B	
$E_s =$	200000 N/mm <sup>2</sup>	$E_s =$	200000 N/mm <sup>2</sup>
$f_{yk} =$	500 N/mm <sup>2</sup>	$f_{yk} =$	500 N/mm <sup>2</sup>
$f_{tk} =$	540 N/mm <sup>2</sup>	$f_{tk} =$	540 N/mm <sup>2</sup>
$\epsilon_{uk} =$	50.0 ‰	$\epsilon_{uk} =$	50.0 ‰
$\epsilon_{ud} =$	45.0 ‰	$\epsilon_{ud} =$	45.0 ‰

Partial safety factor :

$\gamma_s = 1.15$                        $\gamma_s = 1.15$

permitted stresses in SLS :

$\sigma_s \leq 400$  N/mm<sup>2</sup>     $\sigma_s \leq 400$  N/mm<sup>2</sup> (0.80 \*  $f_{yk}$ )

**Requirements durability:**

	top		bottom
attack on concrete	X0		X0
attack on reinforc.	XC1		XC1
min. concrete class	C 20/25		C 20/25
stirrup	$\phi, l = 8$ mm		
long. reinforcement	$\phi, m = 20$ mm		$\phi, m = 16$ mm
prestressed steel	$d_p = 12.3$ mm strand		
allowance in design	$\Delta C_{dev} = 5$ mm *2		$\Delta C_{dev} = 5$ mm *2
stirrup	$C_{min, l} = 15$ mm		$C_{min, l} = 15$ mm
concrete coverage	$C_{nom, l} = 20$ mm		$C_{nom, l} = 20$ mm
longitudinal bars	$C_{min, m} = 20$ mm *5		$C_{min, m} = 16$ mm *5
concrete coverage	$C_{nom, m} = 28$ mm *1		$C_{nom, m} = 28$ mm *1
prestressing steel :	$C_{min, p} = 19$ mm *5		$C_{min, p} = 19$ mm *5
concrete coverage	$C_{nom, p} = 28$ mm *1		$C_{nom, p} = 28$ mm *1
laying dist. link	$C, l = 20$ mm		$C, l = 20$ mm
all. crack width	$w_{max} = 0.20$ mm		$w_{max} = 0.20$ mm
decompression	not req.		not req.

\*1: with  $c_{min, l}$   
\*2: Quality Control  
\*5: bond decisive

**Concrete:**

Precast

C 50/60	
$f_{ck} =$	50.00 N/mm <sup>2</sup>
$\alpha_{cc} =$	0.85
$f_{ctk0.05} =$	2.85 N/mm <sup>2</sup>
$\alpha_{ct} =$	1.00
$\gamma =$	25.00 kN/m <sup>3</sup> Unit
$E_{cm} =$	37000 N/mm <sup>2</sup>
$\alpha_E =$	1.00 Coeff. E-module
$G_{cm} =$	14800 N/mm <sup>2</sup>

Partial safety factor :

$\gamma_c = 1.50$

permitted stresses in SLS :

char. Lc	$\sigma_c \geq -30.00$ N/mm <sup>2</sup>
q.perm.Lc	$\sigma_c \geq -22.50$ N/mm <sup>2</sup>
Removal the anchor $t = t_{OT}(sto) = 5.1$ d	
	$f_{cm(t)} = 44.43$ N/mm <sup>2</sup>
	$f_{ck(t)} = 36.43$ N/mm <sup>2</sup>
linear creep	$\sigma_c \geq -16.39$ N/mm <sup>2</sup> (k2=0.45)
maximum	$\sigma_c \geq -25.50$ N/mm <sup>2</sup> (k6=0.70)

**Creep modulus & shrinkage strain**

with heat treatment in stressing mould  
 $t_{t0} = 60$  °C (until releasing the anchor)  
 $t_{eq} = 4533$  h (equivalent time difference for relaxation)  
 $t_{OT} = 5.1$  d (according to temperature adjusted concrete age)  
 CementStrength class 42,5R;52,5  
 $\rho = 0.5$  (Aging coefficient)  
 Reference point for  $t_0$  is the start of the concreting of the precast



Creep	t0 Days	RH %
Storage	1	70
Utilization precast	21	50

L.	Segment	Part-cross-section	t0	t	$\alpha$	t <sub>0,eff</sub> B.9	$\beta_{t0}$ B.5	$\beta_H$ B.8	$\beta_{c(t,t0)}$ B.7	$\phi_{RH}$ B.3	$\beta_{fcm}$ B.4	$\phi(t,t0)$ B.1
1	Storage	PcC	1.0	21.0	1	10.2	0.59	475.4	0.38	1.24	2.21	0.62
2	Utilization precast	PcC	21.0	26000.0	1	10.2	0.59	463.7	0.61	1.47	2.21	1.17

L.	A [cm <sup>2</sup> ]	U [cm]	h0 [cm]	$\beta_{ds}(t0,ts)$	$\beta_{ds}(t,ts)$ 3.10	$\beta_{RH}$ B.12	$\epsilon_{cd,0}$ B.11	$\beta_{as}$ 3.13	$\epsilon_{ca}/10e6$ 3.12	$\epsilon_{cs}(t,t0)$ [‰]
1	4013.10	446.8	179.7	0.000	0.172	1.02	402.5	0.60	100.00	0.121
2	4013.10	446.8	179.7	0.172	0.996	1.36	536.0	1.00	100.00	0.430

**Loads:**

**Self weight**

Beam beginning g11 = 6.47 kN/m  
Ridge g12 = 10.03 kN/m  
Beam end g13 = 6.47 kN/m

Total G = 250.1 kN  
Volume V = 10.00 m<sup>3</sup>  
Surf. A = 95.00 m<sup>2</sup>

Units: Single load[kN] Single moment[kNm] line load[kN/m]												
span	type	gle	qle	Dist. a [m]	gri	qri	Length [m]	Fact	Act.	Sim.	Alt.	Pos.
1	1	10.80	4.30					1.00	10	0	0	
1	1	0.00	0.61					1.00	9	0	0	

Load types: 1 = uniformly distr., 2 = single load at a, 3 = single moment at a  
4 = trapezoidal load from a, 5 = triangle load over L

**Actions:**

Act.	$\gamma_Q$	$\psi_0$	$\psi_1$	$\psi_2$	Dep.	Cat.	Description
9	1.50	0.50	0.20	0.00	0	W	Wind loads
10	1.50	0.50	0.20	0.00	0	S	Snow loads <1000m

**Tendons:**

Dist(LE) > 3.5 cm axis horizontal > 3.7 cm vertical > 3.7 cm

lay. No.	number	area Ap [cm <sup>2</sup> ]	Dist.LE Yp [cm]	Prestressing $\sigma_p^{(0)}$ [N/mm <sup>2</sup> ]	<--- Isolations --->		Type 
					Count	to x1 [m] / from x2 [m]	
1	3	2.79	8.5	1000	0		LE
2	3	2.79	12.3	1000	0		LE
3	3	2.79	16.1	1000	0		LE
4	3	2.79	19.9	1000	0		LE
5	3	2.79	23.7	1000	0		LE
6	3	2.79	27.5	1000	0		LE
7	3	2.79	31.3	1000	0		LE
8	1	0.93	35.1	1000	0		LE

x1 and x2 with respect to the left beginning from joint  
LE= parallel lower edge, UE= parallel upper edge  
The calculation of the losses due to creep, shrinkage and relaxation following the method from Abelein



**Untensioned reinforcement:**

Layer No.	number	diam. $\Phi_s, l$ [mm]	area $A_s$ [cm <sup>2</sup> ]	Dist.LE $Y_s$ [cm]	effective range		Type
					from xA [m]	to xE [m]	
1	2	16	4.02	3.6	0.00	30.30	LE
2	2	20	6.28	166.2	0.00	30.30	UE
3	2	20	6.28	155.0	0.00	30.30	UE

xA and xE with respect to the left beginning from joint  
LE= parallel lower edge, UE= parallel upper edge

**Surface reinforcement acc.to Tab. NA.J.41 (B0 < D0) :**

Web (Z1/S3)  $A_{sS} = 1.24 \text{ cm}^2/\text{m}$  (UwkS <= XC4) (per side)  
Top flange (Z3/S1)  $A_{sO} = 0.00 \text{ cm}^2/\text{m}$  (UwkS <= XC4)

**Settings for shear resistance check**

Bearing width, distance bearing edge, effective height of the bearing line  
left  $b_{Al} = 0.15 \text{ m}$   $a_l = 0.07 \text{ m}$   $d_{Al} = 0.92 \text{ m}$   
right  $b_{Ar} = 0.15 \text{ m}$   $a_r = 0.07 \text{ m}$   $d_{Ar} = 0.92 \text{ m}$   
For shear reinforcement not decisive ranges over support A and B:  
 $x_{aRe} = 0.99 \text{ m}$  direct bearing (width of bearing/2 + eff. depth)  
 $x_{bLi} = 0.99 \text{ m}$  direct bearing (width of bearing/2 + eff. depth)

**Check the limit deformation:**

Total sagging	$f \leq L/250$	Increase deflection	$ df  \leq L/500$
Cantilever left	$f \leq 0.1 \text{ cm}$		$ df  \leq 0.1 \text{ cm}$
Span	$f \leq 12.0 \text{ cm}$		$ df  \leq 6.0 \text{ cm}$
Cantilever right	$f \leq 0.1 \text{ cm}$		$ df  \leq 0.1 \text{ cm}$

quasi- permanent combination and eff. char. prestress  
Deflection due to shrinkage considered  
Tension stiffening: Member rigidity, Characteristic combination

**RESULTS ( summary)**

**Reaction forces (t = infinitely):**

Units: all [kN] G:perm., Q:variable., V: Sum

Support point	G	min Q	<-----char. value----->		<--ULS(PT)---->	
			max Q	min V	max V	
A (left)	287.01	0.00	73.65	287.01	462.02	
B (right)	287.01	0.00	73.65	287.01	462.02	

**max. bending moment in erection state(char. value):**

MF = = 2763.72 kNm at x = = 15.15 m

**Checks are not complied with:**

Checkvalue		Extrem		Utilisation	x [m]
Resisting tens force bot	$\eta =$	0.86		1.16	30.15
Crack MinAs+AsDuc bottom A	$A_{sMin} =$	6.7	cm <sup>2</sup>	1.66	15.15
Prc.:Compr.stress t0(sto)	$\sigma_c =$	-27.31	N/mm <sup>2</sup>	1.07	3.75
Buckling installed state (Stiglat)	$\eta =$	1.69		1.19	

**Warning**

Prc.:lin. creep t0(Sto)  $\sigma_c = -23.09 \text{ N/mm}^2$   $x = 0.80 \text{ m}$   
 $\sigma_c < 0.45 * f_{ck}(t) = -16.39 \text{ N/mm}^2$   
\_disproportional creeping by increased creep modulus considered( $f_k = 1.32$ )

**Required shear reinforcement:**

Column A:  $a_{sw} = 5.00 \text{ cm}^2/\text{m}$   
Column B:  $a_{sw} = 5.00 \text{ cm}^2/\text{m}$



**Bursting reinforcement**

left Laying length = 1.02 m  
from x = 0.00 m As = 5.3 cm<sup>2</sup>  
right Laying length = 1.02 m  
from x = 30.30 m As = 5.3 cm<sup>2</sup>

**Check of anchorage**

left: Tensile force resistance in anchoring area Util = 1.16  
additional reinforcement necessary  
right: Tensile force resistance in anchoring area Util = 1.16  
additional reinforcement necessary

**Overview crit. sections**

Selected basic grid: 10 Sections

Checkvalue		Extrem		Utilisation	x [m]	
Flexural capacity bottom	η =	1.17		0.86	19.53	
Flexural capacity top	η =	6.64		0.15	3.75	
Resisting tens force bot	η =	0.86		1.16	30.15	!
Resisting tens force top	η =	6.64		0.15	3.75	
Prc.:Compr.stress t0(sto)	σc =	-27.31	N/mm <sup>2</sup>	1.07	3.75	!
Prc.:Compr.stress Cc	σc =	-22.83	N/mm <sup>2</sup>	0.76	3.75	
Stress in prestress.steel	σp,Cc =	1068.4	N/mm <sup>2</sup>	0.80	19.19	
Stress in rebars	σs =	142.7	N/mm <sup>2</sup>	0.36	10.81	
Crack MinAs+AsDuc bottom A	AsMin =	6.7	cm <sup>2</sup>	1.66	15.15	!
Crack MinAs+AsDuc top A	AsMin =	----	cm <sup>2</sup>	----	----	
Crack width bottom	wk =	0	mm	0.40	11.15	
Crack width top	wk =	0	mm	0.76	3.75	
Sagging top	fo =	-2.5	cm	0.20	13.47	
Sagging bottom	fu =	7.3	cm	0.61	16.83	
Incr.-deflection(Util)	df  =	6.0	cm	1.00	16.83	
Prc.:Shear reinf (web)	asw =	5.00	cm <sup>2</sup> /m	1.00	29.16	
Concrete strut capacity	η =	1.58		0.63	30.08	
---- Check not required						
**** Check not fulfilled						
Prc.:Precast member Add.: in-situ supplement						
IS : Installed state SC : State of construction						
AsDuk:Ductility reinforcement						

Linear creep limit, informative:		Extrem		Utilisation	x [m]
Prc.:lin. creep t0(Sto)	σc =	-23.09	N/mm <sup>2</sup>	1.41	0.80
Prc.:Compression quasi-permanent Lc	σc =	-19.11	N/mm <sup>2</sup>	0.85	1.00

Tensile stress state I, informative:		Extrem		Utilisation	x [m]
Prc.:Tens.stress (IS)	σt =	9.52	N/mm <sup>2</sup>	2.34	10.14
Prc.:Tens.stress (SC)	σt =	3.01	N/mm <sup>2</sup>	1.19	0.80

**Internal forces ULS [kN,kNm]**

x [m]	Design sit. permanent/transient				from prestressing ( formwork state)				
	Min My	Max My	Min Qz	Max Qz	Sto.tA Nv	Sto.tA Mv	Use.tE Nv	Use.tE Mv	PRE Deg
0.00	0.00	0.00	0.0	0.0	0.0	0.00	0.0	0.00	0.00
0.15	-0.10	-0.07	-1.3	-1.0	-300.0	-113.15	75.2	-16.91	2.41
0.15	-0.10	0.43	-1.3	460.8	-305.6	-115.28	72.7	-17.94	2.26
0.80	-2.83	293.41	-7.1	442.2	-1951.4	-771.31	-787.4	-359.95	1.66
1.00	-4.43	381.28	-8.9	436.5	-1956.7	-784.23	-1001.6	-467.11	2.00
1.35	-8.10	532.27	-12.1	426.4	-1956.7	-803.11	-1225.3	-591.58	2.30
1.36	-8.22	536.53	-12.2	426.1	-1956.7	-803.65	-1225.8	-592.43	2.28
3.37	-51.67	1334.23	-31.3	367.5	-1956.7	-911.27	-1317.2	-752.12	1.15
3.75	-64.26	1471.73	98.4	356.2	-1956.7	-931.47	-1327.8	-779.14	1.08
6.73	197.38	2400.70	75.4	266.8	-1956.7	-1088.60	-1386.4	-974.98	0.82
10.10	406.74	3125.02	46.9	162.5	-1956.7	-1263.95	-1416.4	-1164.27	0.75
11.15	451.87	3278.28	37.5	129.3	-1956.7	-1318.17	-1420.4	-1216.76	0.74
13.47	515.66	3492.30	15.8	54.9	-1956.7	-1437.39	-1423.1	-1322.50	0.76
15.15	529.63	3538.52	-0.7	0.7	-1956.7	-1523.27	-1420.7	-1390.67	0.79
16.83	515.66	3492.30	-54.9	-15.8	-1956.7	-1437.39	-1423.1	-1322.50	0.76



x [m]	Design sit. permanent/transient				from prestressing ( formwork state)				
	Min My	Max My	Min Qz	Max Qz	Sto.tA Nv	Sto.tA Mv	Use.tE Nv	Use.tE Mv	PRE Deg
20.20	406.76	3125.02	-162.5	-46.9	-1956.7	-1263.95	-1416.4	-1164.27	0.75
23.57	197.39	2400.70	-266.8	-75.4	-1956.7	-1088.60	-1386.4	-974.98	0.82
26.55	-64.22	1471.73	-356.2	35.0	-1956.7	-931.47	-1327.8	-779.14	1.08
26.93	-51.64	1334.23	-367.5	31.2	-1956.7	-911.27	-1317.2	-752.12	1.15
28.94	-8.21	536.53	-426.1	12.2	-1956.7	-803.65	-1225.8	-592.43	2.28
28.95	-8.09	532.27	-426.4	12.1	-1956.7	-803.11	-1225.3	-591.58	2.30
29.16	-5.76	442.10	-432.4	10.2	-1956.7	-791.79	-1149.6	-543.73	2.35
30.08	-0.21	32.11	-458.8	1.9	-481.2	-182.49	-12.7	-52.60	1.61
30.15	-0.10	0.43	-460.8	1.3	-305.6	-115.28	72.7	-17.94	2.26
30.15	-0.10	-0.07	1.0	1.3	-300.0	-113.15	75.2	-16.91	2.41
30.30	0.00	0.00	0.0	0.0	0.0	0.00	0.0	0.00	0.00

Internal forces SLS

x [m]	<- char. Lc->		<- freq. Lc->		<q- perm. Lc>	
	Min My	Max My	Min My	Max My	Min My	Max My
0.00	0.00	0.00	0.00	0.00	0.00	0.00
0.15	-0.07	-0.07	-0.07	-0.07	-0.07	-0.07
0.15	-0.07	0.32	-0.07	0.26	-0.07	0.24
0.80	-2.10	226.11	-2.10	190.39	-2.10	182.18
1.00	-3.28	293.83	-3.28	247.44	-3.28	236.78
1.35	-6.00	410.22	-6.00	345.50	-6.00	330.64
1.36	-6.09	413.50	-6.09	348.27	-6.09	333.29
3.37	-38.27	1028.49	-38.27	867.02	-38.27	829.94
3.75	-47.60	1134.52	-47.60	956.56	-47.60	915.69
6.73	214.02	1851.08	214.02	1562.52	214.02	1496.25
10.10	423.39	2410.09	423.39	2036.53	423.39	1950.74
11.15	468.52	2528.41	468.52	2137.06	468.52	2047.19
13.47	532.31	2693.69	532.31	2277.66	532.31	2182.13
15.15	546.28	2729.40	546.28	2308.09	546.28	2211.34
16.83	532.31	2693.69	532.31	2277.66	532.31	2182.13
20.20	423.40	2410.09	423.40	2036.53	423.40	1950.74
23.57	214.04	1851.08	214.04	1562.52	214.04	1496.25
26.55	-47.57	1134.52	-47.57	956.56	-47.57	915.69
26.93	-38.25	1028.49	-38.25	867.02	-38.25	829.94
28.94	-6.08	413.50	-6.08	348.27	-6.08	333.29
28.95	-5.99	410.22	-5.99	345.50	-5.99	330.64
29.16	-4.26	340.71	-4.26	286.93	-4.26	274.59
30.08	-0.16	24.73	-0.16	20.81	-0.16	19.91
30.15	-0.07	0.32	-0.07	0.26	-0.07	0.24
30.15	-0.07	-0.07	-0.07	-0.07	-0.07	-0.07
30.30	0.00	0.00	0.00	0.00	0.00	0.00

x[m]	<Flex. capacity->			<-----resisting tensile force----->				
	$\eta_{bo}$ =M <sub>Rd</sub> /M <sub>Ed</sub>	$\eta_{to}$ =M <sub>Rd</sub> /M <sub>Ed</sub>	$\eta_{bo}$ =T <sub>Rd</sub> /T <sub>Ed</sub>	$\sigma/\sigma_R$ [N/mm <sup>2</sup> ]	al [cm]	$\eta_{to}$ =T <sub>Rd</sub> /T <sub>Ed</sub>	$\sigma/\sigma_R$ [N/mm <sup>2</sup> ]	al [cm]
0.00	---	---	---	0.00#	---	---	0.00#	---
0.08	---	---	---	0.00#	---	438.69	0.00#	43.0
0.15	---	---	---	0.00#	---	344.37	0.00#	43.2
0.15	---	---	0.86	0.00#	103.7	342.39	0.00#	43.2
0.20	88.35	---	1.01	0.00#	103.9	291.79	0.00#	43.3
0.40	18.09	699.13	1.53	0.00#	105.1	136.69	0.00#	43.8
0.60	10.31	283.22	1.94	0.00#	106.2	74.87	3.09*!	44.3
0.80	7.27	118.53	2.25	0.00#	107.3	48.00	4.18*!	44.8
1.00	5.67	76.13	2.54	0.00#	108.4	36.30	4.22*!	45.3
1.20	4.71	53.14	2.54	1.59#	109.5	28.21	4.26*!	45.8
1.35	4.20	42.15	2.41	1.50#	110.3	23.76	4.29*!	46.1
1.36	4.17	41.54	2.40	1.49#	110.4	23.50	4.29*!	46.2
1.40	4.05	40.52	2.37	1.47#	110.6	23.00	4.30*!	46.3
1.60	3.58	32.15	2.23	1.11#	111.7	18.93	4.34*!	46.8
1.80	3.22	25.55	2.10	1.03#	112.8	15.47	4.38*!	47.3
2.00	2.90	20.81	1.99	0.97#	114.0	13.08	4.43*!	47.8
3.37	1.92	8.15	1.63	5.93*!	121.6	7.67	4.83*!	51.1
3.75	1.79	6.64	1.56	7.51*!	123.7	6.64	4.97*!	96.0
6.73	1.30	---	1.26	15.14*!	88.6	---	0.02#	---



x[m]	<Flex. capacity->			<-----resisting tensile force----->				
	$\eta_{bo}$ = $M_{Rd}/M_{Ed}$	$\eta_{to}$ = $M_{Rd}/M_{Ed}$	$\eta_{bo}$ = $T_{Rd}/T_{Ed}$	$\sigma/\sigma_R$ [N/mm <sup>2</sup> ]	al [cm]	$\eta_{to}$ = $T_{Rd}/T_{Ed}$	$\sigma/\sigma_R$ [N/mm <sup>2</sup> ]	al [cm]
10.10	1.17	---	1.17	17.18*!	70.7	---	0.00#	---
11.15	1.17	---	1.17	16.94*!	73.3	---	0.00#	---
13.47	1.22	---	1.20	15.42*!	79.0	---	0.00#	---
16.83	1.22	---	1.21	15.42*!	79.0	---	0.00#	---
20.20	1.17	---	1.17	17.18*!	70.7	---	0.00#	---
23.57	1.30	---	1.26	15.14*!	88.6	---	0.02#	---
26.55	1.79	6.65	1.56	7.51*!	123.7	6.65	4.97*!	52.1
26.93	1.92	8.16	1.63	5.93*!	121.6	7.58	4.83*!	51.1
28.30	2.90	20.83	1.99	0.97#	114.0	13.09	4.43*!	47.8
28.50	3.22	25.58	2.10	1.03#	112.8	15.48	4.38*!	47.3
28.70	3.58	32.19	2.23	1.11#	111.7	18.95	4.34*!	46.8
28.90	4.05	40.58	2.37	1.47#	110.6	23.02	4.30*!	46.3
28.94	4.17	41.60	2.40	1.49#	110.4	23.53	4.29*!	46.2
28.95	4.20	42.21	2.41	1.50#	110.3	23.78	4.29*!	46.1
29.10	4.71	53.23	2.54	1.59#	109.5	28.25	4.26*!	45.8
29.30	5.67	76.28	2.54	0.00#	108.4	36.35	4.22*!	45.3
29.50	7.27	118.81	2.25	0.00#	107.3	48.07	4.18*!	44.8
29.70	10.31	284.02	1.94	0.00#	106.2	75.01	3.09*!	44.3
29.90	18.09	701.62	1.53	0.00#	105.1	136.99	0.00#	43.8
30.10	88.35	---	1.01	0.00#	103.9	292.58	0.00#	43.3
30.15	---	---	0.86	0.00#	103.7	343.36	0.00#	43.2
30.15	---	---	---	0.00#	---	345.35	0.00#	43.2
30.22	---	---	---	0.00#	---	440.04	0.00#	43.0
30.30	---	---	---	0.00#	---	---	0.00#	---

---- Check not required

\*\*\*\* Check not fulfilled

#:Main tens.stress  $\sigma$  #!:  $\sigma > f_{ctk0.05}$

\*:Edge tens. str.  $\sigma_R$  \*!:  $\sigma_R > f_{ctk0.05}$

Concrete stresses precast

x [m]	$\sigma_{c,1}$ [N/mm <sup>2</sup> ]	$\sigma_{c,2}$ [N/mm <sup>2</sup> ]	$\sigma_{c,Cc}$ [N/mm <sup>2</sup> ]	$\sigma_{c,Qc}$ [N/mm <sup>2</sup> ]	$\sigma_{t,Cc}$ [N/mm <sup>2</sup> ]	$\sigma_{t,SC}$ [N/mm <sup>2</sup> ]
0.08	-1.56	-1.56	-0.82	-0.82	1.52	0.34
0.15	-3.76	-3.76	-2.87	-2.87	0.92	0.67
0.15	-3.83	-3.83	-2.94	-2.93	0.92	0.68
0.68	-18.93	-22.44	-16.91	-16.91	1.14	2.56
0.80	-23.09	-26.50	-15.49	-15.49	1.21	3.01
0.83	-23.02	-26.57	-15.35	-15.35	1.11	2.97
1.00	-21.70	-26.55	-19.11	-19.11	0.50	2.71
1.14	-21.28	-26.55	-19.80	-18.63	0.01	2.50
1.35	-20.67	-26.55	-21.05	-18.08	---	2.21
1.36	-20.64	-26.55	-21.06	-18.05	---	2.19
3.37	-16.00	-27.10	-22.61	-14.17	0.56	4.68
3.75	-15.31	-27.31	-22.83	-13.56	1.77	4.78
6.73	-11.52	-17.59	-16.23	-10.16	7.72	2.28
10.10	-9.48	-14.30	-15.81	-10.67	9.52	1.03
13.47	-8.85	-12.78	-14.49	-9.69	8.44	0.81
15.15	-8.88	-12.46	-13.01	-8.71	7.25	0.96
16.83	-8.85	-12.78	-14.49	-9.69	8.44	0.81
20.20	-9.48	-14.30	-15.81	-10.67	9.52	1.03
23.57	-11.52	-17.59	-16.23	-10.16	7.72	2.28
26.55	-15.31	-27.31	-22.83	-13.56	1.77	4.78
26.93	-16.00	-27.10	-22.61	-14.17	0.56	4.68
28.94	-20.64	-26.55	-21.06	-18.05	---	2.19
28.95	-20.67	-26.55	-21.05	-18.08	---	2.21
29.16	-21.28	-26.55	-19.80	-18.63	0.01	2.50
29.30	-21.70	-26.55	-19.11	-18.63	0.01	2.50
29.47	-23.02	-26.57	-15.35	-15.35	1.11	2.97
29.50	-23.09	-26.50	-15.49	-15.49	1.21	3.01
29.62	-18.93	-22.44	-16.91	-16.91	1.14	2.56
30.15	-3.83	-3.83	-2.94	-2.93	0.92	0.68





x [m]	$\sigma_{c,1}$ [N/mm <sup>2</sup> ]	$\sigma_{c,2}$ [N/mm <sup>2</sup> ]	$\sigma_{c,Cc}$ [N/mm <sup>2</sup> ]	$\sigma_{c,Qc}$ [N/mm <sup>2</sup> ]	$\sigma_{t,Cc}$ [N/mm <sup>2</sup> ]	$\sigma_{t,SC}$ [N/mm <sup>2</sup> ]
30.15	-3.76	-3.76	-2.87	-2.87	0.92	0.67
30.22	-1.56	-1.56	-0.82	-0.82	1.52	0.34

---- Check not required

\*\*\*\* Check not fulfilled

$\sigma_{c,1}$  : Compression and disproportional creeping check with early strength (storage)

$\sigma_{c,2}$  : Compressive stress check with early strength (erection)

$\sigma_{c,Cc}$  : Compression check Characteristic load combination

$\sigma_{c,Qc}$  : Disproportional creep check quasi-perm. load combination

$\sigma_{t,Cc}$  : Tensile stresses ,Installed state, Characteristic load combination (informative)

$\sigma_{t,SC}$  : Tensile stresses,State of construction (informative)

**Check the limit deformation:**

Total sagging	$f \leq L/250$	Increase deflection	$ df  \leq L/500$
Cantilever left	$f \leq 0.1 \text{ cm}$		$ df  \leq 0.1 \text{ cm}$
Span	$f \leq 12.0 \text{ cm}$		$ df  \leq 6.0 \text{ cm}$
Cantilever right	$f \leq 0.1 \text{ cm}$		$ df  \leq 0.1 \text{ cm}$

quasi- permanent combination and eff. char. prestress

Deflection due to shrinkage considered

Tension stiffening: Member rigidity, Characteristic combination

x [m]	Storage		Utilization		df  [cm]
	ftA [cm]	ftE [cm]	ftA [cm]	ftE [cm]	
0.00	0.0	0.1	-0.0	-0.1	-0.1
3.37	-0.9	-1.2	0.3	2.4	2.1
6.73	-1.4	-1.9	0.8	4.8	4.0
10.10	-1.7	-2.3	1.2	6.6	5.4
13.47	-1.8	-2.5	1.4	7.3	6.0
16.83	-1.8	-2.5	1.4	7.3	6.0
20.20	-1.7	-2.3	1.2	6.6	5.4
23.57	-1.4	-1.9	0.8	4.8	4.0
26.93	-0.9	-1.2	0.3	2.4	2.1
30.30	0.0	0.1	-0.0	-0.1	-0.1

$|df| = ftE(\text{service}) - ftA(\text{service})$

**Shear resistance**

x [m]	$V_{Ed}$ [kN]	$V_{Ed,red}$ [kN]	cot $\Theta$	z [cm]	asw,Web [cm <sup>2</sup> /m]	$\eta = V_{Rd,max}/V_{Ed}$
0.08	0.7	----	1.00	58.4	2.15	---
0.22	456.5	----	2.50*	68.9	5.00	1.58
0.23	455.9	----	2.50*	69.1	5.00	1.59
1.14	402.9	402.9	2.50	74.2	5.00	2.15
1.35	391.4	391.4	2.50	75.3	4.78	2.26
1.36	390.8	390.8	2.50	75.3	4.77	2.27
3.37	289.9	289.9	2.50	85.2	3.13	2.65
3.75	272.4	272.4	2.50	86.9	2.88	3.09
6.73	149.8	149.8	1.58	101.6	2.15	10.40
10.10	41.0	41.0	1.00	118.5	2.15	41.18
13.47	73.4	73.4	1.00	134.8	2.15	30.71
15.15	122.4	122.4	1.00	143.1	2.15	19.47
16.83	73.4	73.4	1.00	134.8	2.15	30.71
20.20	41.0	41.0	1.00	118.5	2.15	41.18
23.57	149.8	149.8	1.58	101.6	2.15	10.40
26.55	272.4	272.4	2.50	86.9	2.88	3.09
26.93	289.9	289.9	2.50	85.2	3.13	2.65
28.94	390.8	390.8	2.50	75.3	4.77	2.27
28.95	391.4	391.4	2.50	75.3	4.78	2.26
29.16	402.9	402.9	2.50	74.2	5.00	2.15
30.08	456.5	----	2.50*	68.9	5.00	1.58
30.22	0.7	----	1.00	58.4	2.15	---

---- Check not required


\*\*\*\* Check not fulfilled

\*: Take over from last construction phase




Internal forces

- max MEd from external loads (PT)
- min MEd from external loads (PT)
- × Moment from prestressing, t= tA storage
- + Moment from prestressing, t= tE use

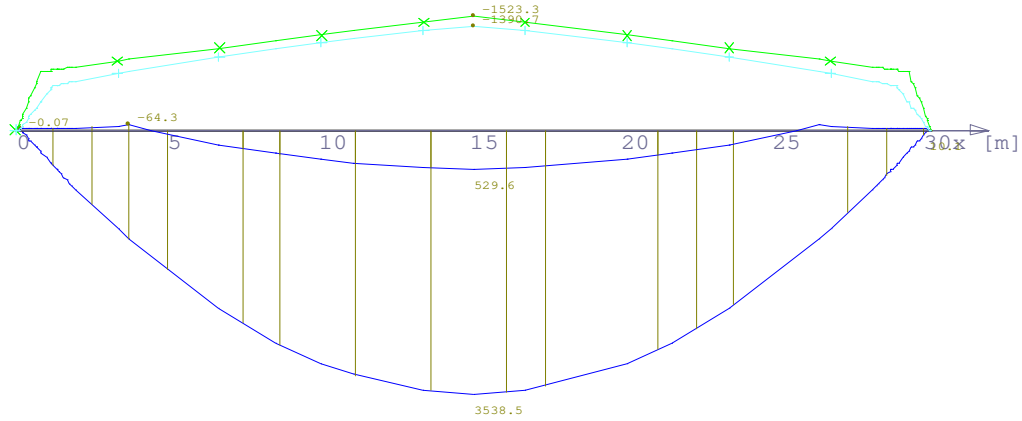


- max VEd from external loads (PT)
- min VEd from external loads (PT)

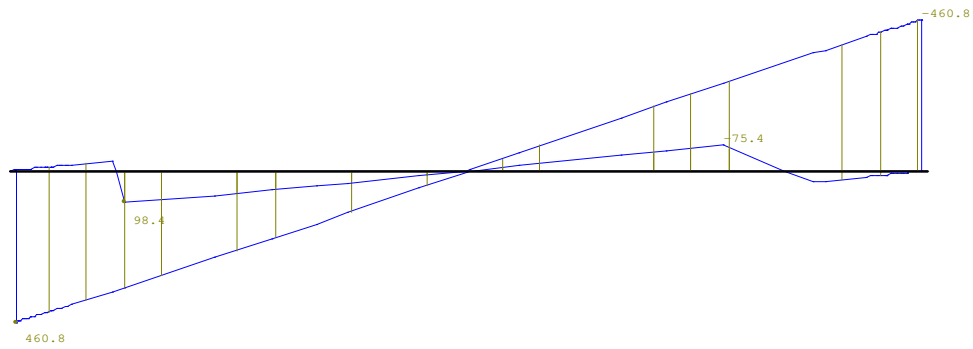




Bending resistance (failure safety)

— Flexural capacity bottom	$\eta = 1,17$	$x=19,53$ m
x Flexural capacity top	$\eta = 6,64$	$x= 3,75$ m
+ Resisting tens force bot	$\eta = 0,86$	$x=30,15$ m
o Resisting tens force top	$\eta = 6,64$	$x= 3,75$ m

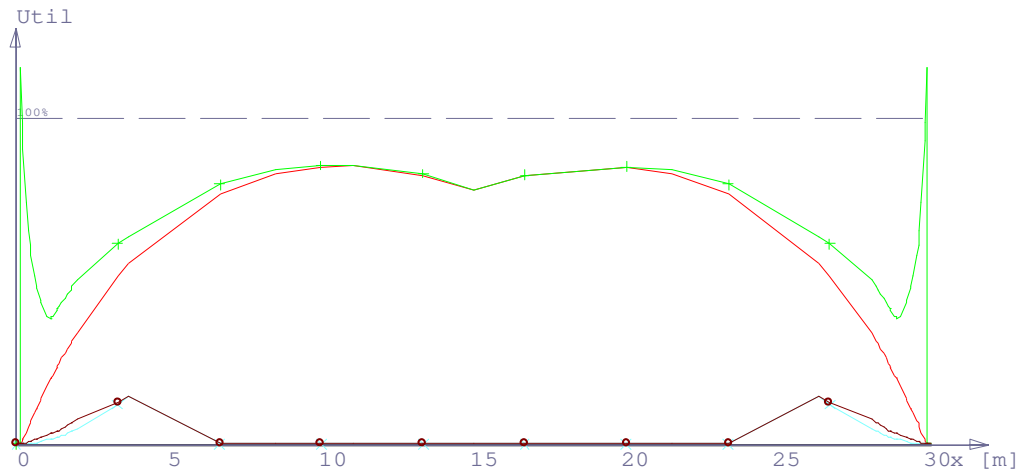

Ultimate stress precast component


— Prc.:Compr.stress Cc	$\sigma_c = -22,83$ N/mm <sup>2</sup>	$x= 3,75$ m
x Prc.:Compr.stress t0(sto)	$\sigma_c = -27,31$ N/mm <sup>2</sup>	$x= 3,75$ m
+ Prc.:Tens.stress (IS)	> 100% condition	II, informative only
o Prc.:Tens.stress (SC)	> 100% condition	II, informative only

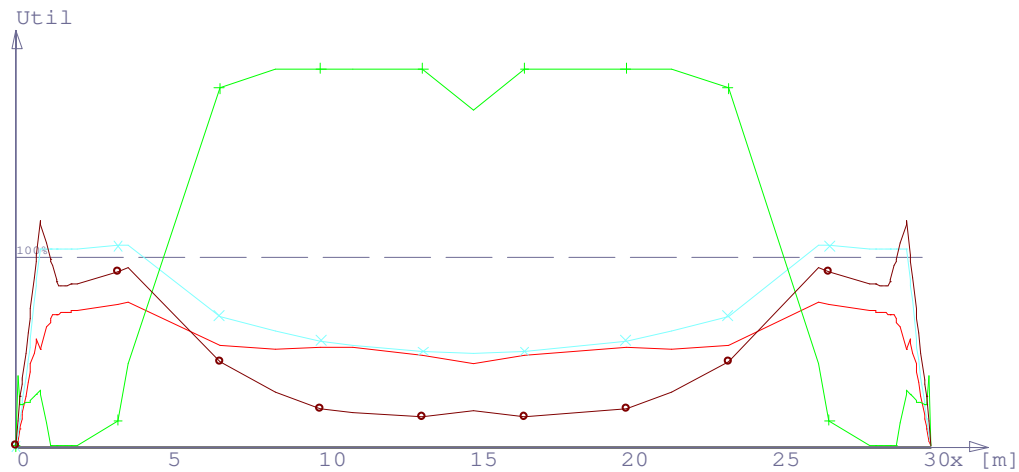




Deformation

— Sagging t=tA storage -1,83 cm  
x Sagging t=tE storage -2,45 cm  
+ Sagging t=tA utilisatio 1,36 cm  
o Sagging t=tE utilisatio 7,34 cm

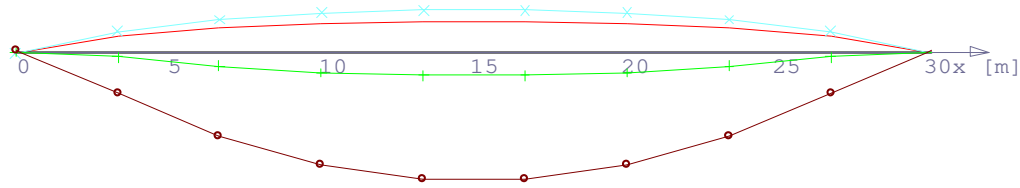

Shear force resistance (shear covering)

— Prc.:Shear reinf (web) a<sub>sw</sub> = 5,00 cm<sup>2</sup>/m x=29,16 m  
+ Concrete strut capacity η = 1,58 x=30,08 m

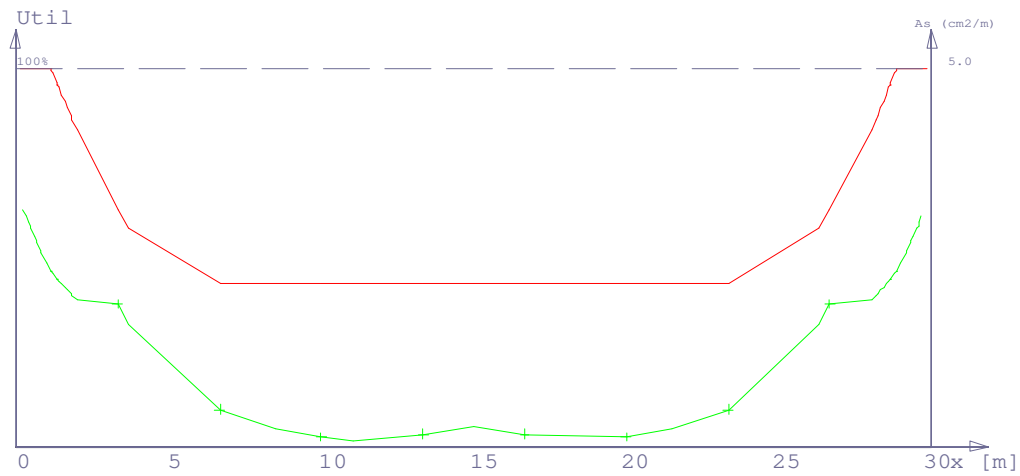

**Selected section x = 11.00 m from left support**

Internal force combinations from external loading  
 LAc: dominant variable action (leading action)  
 ULS-PT : permanent + transient design situation (fundam. combination)  
 SLS-Cc : characteristic combination  
 SLS-Fc : frequent combination  
 SLS-Qc : quasi-permanent combination

**maximum moment : [kNm]**

	ULS-PT	SLS-Cc	SLS-Fc	SLS-Qc
Storage	1240.12	918.59	918.59	918.59
Storage/Erection	649.16	468.52	468.52	468.52
Utilization	3278.28	2528.41	2137.06	2047.19
LAc	10	10	10	-



**Minimum moment : [kNm]**

	ULS-PT	SLS-Cc	SLS-Fc	SLS-Qc
Storage	918.56	918.59	918.59	918.59
Storage/Erection	451.87	468.52	468.52	468.52
Utilization	2047.16	2047.19	2047.19	2047.19
LAc	-	-	-	-

**maximum shear force:[kN]**

	ULS-PT
Storage	51.6
Storage/Erection	52.4
Utilization	129.3
LAc	10

**Effective Tendons ( prestressed formwork state for t = t0 (sto))**

Layer No.	No.	Area Ap [cm <sup>2</sup> ]	Distance f.bottom [cm]	Prestress		tens.force		Shorttime Relaxation [N/mm <sup>2</sup> ]
				max [N/mm <sup>2</sup> ]	min [N/mm <sup>2</sup> ]	max [kN]	min [kN]	
1	3	2.8	8.5	956.37	956.37	266.8	266.8	-4.63
2	3	2.8	12.3	956.37	956.37	266.8	266.8	-4.63
3	3	2.8	16.1	956.37	956.37	266.8	266.8	-4.63
4	3	2.8	19.9	956.37	956.37	266.8	266.8	-4.63
5	3	2.8	23.7	956.37	956.37	266.8	266.8	-4.63
6	3	2.8	27.5	956.37	956.37	266.8	266.8	-4.63
7	3	2.8	31.3	956.37	956.37	266.8	266.8	-4.63
8	1	0.9	35.1	956.37	956.37	88.9	88.9	-4.63

$\Delta\sigma(Tt_0) = -39 \text{ N/mm}^2$  due to heat treatment

**Untensioned reinforcement**

Layer	Number	Diameter [mm]	Area [cm <sup>2</sup> ]	LE [cm]
1	2	16	4.0	3.6
2	2	20	6.3	135.2
3	2	20	6.3	146.4

**Cross-section Precast :**

Layer of cross-section from top to bottom				
Nr	Width [cm]	Distance [cm]	Remarks	
1	60.0	0.0		
2	60.0	15.0		
3	19.0	23.2	Web begin	
4	19.0	150.2	Web end	

**Cross-section Values**

	brutto			ideal		
	A <sub>c</sub> [cm <sup>2</sup> ]	z <sub>u</sub> [cm]	I <sub>c</sub> [cm <sup>4</sup> ]	A <sub>i</sub> [cm <sup>2</sup> ]	z <sub>i</sub> [cm]	I <sub>i</sub> [cm <sup>4</sup> ]
Precast cross-section	3636.9	89.2	8019344	3797.3	88.0	8768771

**Internal forces from prestress (mean values, prestressed formwork state)**

Creep period	N <sub>pm</sub> <sup>(0)</sup>		M <sub>pm</sub> <sup>(0)</sup>	
	tB [kN]	tE [kN]	tB [kNm]	tE [kNm]
Storage	-1956.7	-1793.6	-1318.17	-1254.74
Utilization	-1793.6	-1420.4	-1254.74	-1216.76

tA=Begin, tE=End creep period



Prestress steel relaxation			
Lay. No.		Storage $\Delta\sigma_{p,r1}$ [N/mm <sup>2</sup> ]	Utilization $\Delta\sigma_{p,r2}$ [N/mm <sup>2</sup> ]
1		-0.10	-13.00
2		-0.10	-12.94
3		-0.11	-12.89
4		-0.11	-12.84
5		-0.11	-12.79
6		-0.11	-12.73
7		-0.11	-12.68
8		-0.11	-12.63

Prestr. steel, losses due to creeping, shrinking and relaxation:			
Lay. No.		Storage $\Delta\sigma_{p,csr1^{(0)}}$ [N/mm <sup>2</sup> ]	Utilization $\Delta\sigma_{p,csr2^{(0)}}$ [N/mm <sup>2</sup> ]
1		-50.61	-75.05
2		-50.09	-77.17
3		-49.57	-79.29
4		-49.05	-81.41
5		-48.54	-83.53
6		-48.02	-85.65
7		-47.50	-87.77
8		-46.98	-89.89

Stress in rebars due to creeping,shrinking and relaxation:			
Lay. No.		Storage $\Delta\sigma_{s,csr1^{(0)}}$ [N/mm <sup>2</sup> ]	Utilization $\Delta\sigma_{s,csr2^{(0)}}$ [N/mm <sup>2</sup> ]
1		-52.51	-63.45
2		-34.06	-140.25
3		-32.50	-146.79

**Bending with Normal Force ULS**

L.	Creep period	Cross-section	Tens-zone	z [cm]	M <sub>Rd</sub> [kNm]	M <sub>Ed</sub> [kNm]	η (>1.0)	
1	tB Storage	P	top	119.4	634.58	M <sub>Ed</sub> < 0	n/a	#1
2	tE Storage	P	bottom	123.7	3829.99	1240.12	3.09	
3	tB Storage/Erection	P	top	119.4	634.58	M <sub>Ed</sub> < 0	n/a	#1
4	tE Storage/Erection	P	bottom	123.7	3829.99	649.16	5.90	
5	tE Utilization	P	top	125.0	781.51	M <sub>Ed</sub> < 0	n/a	
6	tE Utilization	P	bottom	123.4	3843.82	3278.28	1.17	

#1: f<sub>ck</sub>(t)= 0.73 \* f<sub>ck</sub>

Interim results : Ultimate elongation and internal forces										
L.	ε <sub>c</sub> [%o]	ε <sub>s</sub> [%o]	x [cm]	A <sub>p</sub> [cm <sup>2</sup> ]	A <sub>s</sub> [cm <sup>2</sup> ]	Z <sub>p</sub> [kN]	Z <sub>s</sub> [kN]	D <sub>c</sub> [kN]	D <sub>p</sub> [kN]	D <sub>s</sub> [kN]
1	3.500	5.500	56.9	0.0	12.6	0.0	549.1	1807.6	-1441.6	166.9
2	3.500	21.900	20.2	20.5	4.0	2962.2	180.5	2730.3	0.0	380.1
3	3.500	5.500	56.9	0.0	12.6	0.0	549.1	1807.6	-1441.6	166.9
4	3.500	21.900	20.2	20.5	4.0	2962.2	180.5	2730.3	0.0	380.1
5	3.500	9.500	39.4	0.0	12.6	0.0	551.9	1717.7	-1308.2	163.9
6	3.500	22.700	19.6	20.5	4.0	2967.4	180.7	2660.2	0.0	468.0



**Shear Resistance**

Design value shear force						
L.	Creep period	Combination	$V_{Ed,0}$ [kN]	$M_{Ed}$ [kNm]	$dV$ [kN]	due to
1	tB Storage	QMax	51.6	1240.10	-49.6	Vccd
2	tE Storage	QMax	51.6	1240.10	-49.6	Vccd
3	tB Storage/Erection	QMax	52.4	637.91	-25.5	Vccd
4	tE Storage/Erection	QMax	52.4	637.91	-25.5	Vccd
5	tB Utilization	MMax	129.3	3278.28	-131.5	Vccd
6	tE Utilization	MMax	129.3	3278.28	-131.5	Vccd

Effective cross-section									
L.	Cross-section	Tens-zone	$b_w$ [cm]	$d$ [cm]	$z$ [cm]	$A_c$ [cm <sup>2</sup> ]	$A_{sI}$ [cm <sup>2</sup> ]	$\sigma_{cp}$ [N/mm <sup>2</sup> ]	$V_{Rdc}$ [kN]
1	P	bottom	19.0	146.6	123.7	3636.9	24.5	4.84	347.6
2	P	bottom	19.0	146.6	123.7	3636.9	24.5	4.44	347.0
3	P	bottom	19.0	146.6	123.7	3636.9	24.5	4.84	347.6
4	P	bottom	19.0	146.6	123.7	3636.9	24.5	4.44	347.0
5	P	bottom	19.0	146.6	123.4	3636.9	24.5	4.44	347.0
6	P	bottom	19.0	146.6	123.4	3636.9	24.5	3.52	308.4

Shear design $v1 = 0.480$									
L.	$V_{Ed}$ [kN]	$V_{Ed,red}$ [kN]	$a_{cw}$	$\cot \Theta$	$a_{sw}$ [cm <sup>2</sup> /m]	Note	$a_I$ [cm]	$V_{Rd,max}$ [kN]	
1	2.0	2.0	1.199	1.000	1.83	Min	73.3	1754.2	#1
2	2.0	2.0	1.133	1.000	2.15	Min	73.3	2130.3	
3	26.8	26.8	1.199	1.000	1.83	Min	73.3	1754.2	#1
4	26.8	26.8	1.133	1.000	2.15	Min	73.3	2130.3	
5	2.2	2.2	1.133	1.000	2.15	Min	73.3	2125.8	
6	2.2	2.2	1.105	1.000	2.15	Min	73.3	2073.9	

#1:  $f_{ck}(t) = 0.73 * f_{ck}$

**Check of crack width limit in SLS**

perm. crack width:  $w_k < 0$  mm, Frequent load combination

L.	Creep period	Cross-section	Tens-zone	$r_{sup}$ $r_{inf}$	$\max. \sigma_s$ [N/mm <sup>2</sup> ]	$s_{r,max}$ [mm]	$\epsilon_{sm} - \epsilon_{cm}$ [‰]	$w_k$ [mm]
1	tB Storage	P	top	1.00	CS completely compressed no cracks	128.75	0.386	0
2	tE Storage	P	bottom	1.00				
3	tB Storage/Erection	P	top	1.00				
4	tE Storage/Erection	P	bottom	1.00				
5	tE Utilization	P	top	1.00				
6	tE Utilization	P	bottom	1.00				

Internal forces and elongation								
L.	$N_{ges}$ [kN]	$M_{ges}$ [kNm]	State I			State II		
			$\max. \sigma$ [N/mm <sup>2</sup> ]	XOI [cm]	$\phi_{eff}$	$\epsilon_c$ [‰]	XOII [cm]	
1	-1956.7	-399.59	-2.32	201.0	1.78	-0.775	80.1	
2	-1793.6	-336.16	-8.10	211.2				
3	-1956.7	-849.65	0.88	141.1				
4	-1793.6	-786.22	-12.61	140.6				
5	-1420.4	830.43	-9.64	101.7				
6	-1420.4	920.30	5.49	97.9				

XOI: Pressure zone height in state I XOII: Pressure zone height in state II

L.	$h_{c,ef}$ [cm]	$A_{ceff}$ [cm <sup>2</sup> ]	$\xi_1$	$A_p$ [cm <sup>2</sup> ]	$A_s$ [cm <sup>2</sup> ]	$\rho_{p,ef}$ [‰]	$\rho_{tot}$ [‰]	k1	k2	k3	c [cm]	k4
6	23.4	444.1	1.15	11.2	4.0	4.257	3.418	1.38	0.50	3.40	2.8	0.425



Internal forces cracking and strains (state II)							
L.	N <sub>ges</sub> [kN]	M <sub>ges</sub> [kNm]	State I		State II		
			max. σ [N/mm <sup>2</sup> ]	X0I [cm]	φ <sub>eff</sub>	ε <sub>c</sub> [‰]	X0II [cm]
6	-1420.4	778.83	4.07	104.4			

X0I: Pressure zone height in state I X0II: Pressure zone height in state II

**Minimum reinforcement for crack control:**

L.	Creep period	Cross-section	Tens-zone	r <sub>sup</sub> r <sub>inf</sub>	σ <sub>t</sub> [N/mm <sup>2</sup> ]	req. A <sub>s</sub> [cm <sup>2</sup> ]	exist. A <sub>s</sub> [cm <sup>2</sup> ]
1	tB Storage	P	top	1.00	-1.89	< 4.07	not req.
2	tE Storage	P	bottom	1.00	-8.10	< 4.07	not req.
3	tB Storage/Erection	P	top	1.00	1.31	< 4.07	not req.
4	tE Storage/Erection	P	bottom	1.00	-12.61	< 4.07	not req.
5	tE Utilization	P	top	1.00	-9.37	< 4.07	not req.
6	tE Utilization	P	bottom	1.00	9.42	<= 0 cm <sup>2</sup>	

L.	D [mm]	x0IZ [cm]	A <sub>p</sub> [cm <sup>2</sup> ]	ξ <sub>1</sub>	Web			Flange			
					k	k <sub>c</sub>	A <sub>ct</sub> [cm <sup>2</sup> ]	A <sub>s</sub> [cm <sup>2</sup> ]	k	k <sub>c</sub>	A <sub>ct</sub> [cm <sup>2</sup> ]
6	16	45.8	5.6	1.15	0.65	0.29	871.0	4.3	--no flange--		

x0IZ: tensile zone in state I due to cracking forces

**Ductility reinforcement in precompressed tensile zone:**

b [cm <sup>3</sup> ]	f <sub>ctm</sub> [N/mm <sup>2</sup> ]	Z <sub>s</sub> [cm]	req. A <sub>s</sub> [cm <sup>2</sup> ]	exist. A <sub>s</sub> [cm <sup>2</sup> ]
19	4.07	146.6	5.9	4.0

**Stress checks SLS**

Concrete edge stresses in state I due to prestress, creep, shrinkage and relaxation				
L.	due to	σ <sub>R</sub> Precast		
		top [N/mm <sup>2</sup> ]	bottom [N/mm <sup>2</sup> ]	
1	Prestr. release anchorage	4.20	-18.38	
2	csr storage	-0.02	1.07	
3	csr utilisation	0.71	1.36	

**Tab. Compr stresses of concrete**

L.	Creep period	Cross-section	M <sub>Ed</sub> + = Max - = Min	σ <sub>c</sub> Precast	
				Cc,Pk [N/mm <sup>2</sup> ]	Qc,Pk [N/mm <sup>2</sup> ]
1	tB Storage	P	--	-9.16	-9.16
2	tE Storage	P	--	-8.10	-8.10
3	tB Storage/Erection	P	--	-13.68	
4	tE Storage/Erection	P	--	-12.61	
5	tB Utilization	P	+-	-15.68	-10.57
6	tE Utilization	P	+-	-14.19	-9.53

**Tab. Steel- and Concrete tension stress**

L.	Creep period	Cross-section	M <sub>Ed</sub> + = Max - = Min	σ <sub>p</sub>	σ <sub>s</sub>	σ <sub>t</sub>
				Cc,Pm [N/mm <sup>2</sup> ]	Cc,Pk [N/mm <sup>2</sup> ]	Cc,Pk [N/mm <sup>2</sup> ]
1	tB Storage	P	+-	916.52	< 0	ZII
2	tE Storage	P	+-	873.82	< 0	ZII
3	tB Storage/Erection	P	---	902.22	2.76	0.88
4	tE Storage/Erection	P	+-	859.52	< 0	0.86
5	tB Utilization	P	++	1067.66	124.02	ZII
6	tE Utilization	P	++	1068.31	142.41	ZII

Pk= Prestres char. value, Pm= prestress mean value, StII: State II





**Selected section x = 1.00 m from left support**

Internal force combinations from external loading

LAc: dominant variable action (leading action)

ULS-PT : permanent + transient design situation (fundam. combination)

SLS-Cc : characteristic combination

SLS-Fc : frequent combination

SLS-Qc : quasi-permanent combination

**maximum moment : [kNm]**

	ULS-PT	SLS-Cc	SLS-Fc	SLS-Qc
Storage	162.93	120.67	120.67	120.67
Storage/Erection	-4.35	-4.35	-4.35	-4.35
Utilization	446.42	344.04	289.74	277.27
LAc	10	10	10	-

**Minimum moment : [kNm]**

	ULS-PT	SLS-Cc	SLS-Fc	SLS-Qc
Storage	120.65	120.67	120.67	120.67
Storage/Erection	-5.87	-4.35	-4.35	-4.35
Utilization	277.25	277.27	277.27	277.27
LAc	-	-	-	-

**maximum shear force:[kN]**

	ULS-PT
Storage	158.5
Storage/Erection	-10.3
Utilization	432.1
LAc	10

**Effective Tendons ( prestressed formwork state for t = t0 (sto))**

Layer No.	No.	Area Ap [cm <sup>2</sup> ]	Distance f.bottom [cm]	Prestress		tens.force		Shorttime Relaxation [N/mm <sup>2</sup> ]
				max [N/mm <sup>2</sup> ]	min [N/mm <sup>2</sup> ]	max [kN]	min [kN]	
1	3	2.8	8.5	956.37	912.14	266.8	254.5	-4.63
2	3	2.8	12.3	956.37	912.14	266.8	254.5	-4.63
3	3	2.8	16.1	956.37	912.14	266.8	254.5	-4.63
4	3	2.8	19.9	956.37	912.14	266.8	254.5	-4.63
5	3	2.8	23.7	956.37	912.14	266.8	254.5	-4.63
6	3	2.8	27.5	956.37	912.14	266.8	254.5	-4.63
7	3	2.8	31.3	956.37	912.14	266.8	254.5	-4.63
8	1	0.9	35.1	956.37	912.14	88.9	84.8	-4.63

$\Delta\sigma(Tt_0) = -39 \text{ N/mm}^2$  due to heat treatment

**Untensioned reinforcement**

Layer	Number	Diameter [mm]	Area [cm <sup>2</sup> ]	LE [cm]
1	2	16	4.0	3.6
2	2	20	6.3	85.7
3	2	20	6.3	96.9

**Cross-section Precast :**

Layer of cross-section from top to bottom				
Nr	Width [cm]	Distance [cm]	Remarks	
1	60.0	0.0		
2	60.0	15.0		
3	19.0	23.2	Web begin	
4	19.0	100.7	Web end	



**Cross-section Values**

	brutto			ideal		
	$A_c$ [cm <sup>2</sup> ]	$z_u$ [cm]	$I_c$ [cm <sup>4</sup> ]	$A_i$ [cm <sup>2</sup> ]	$z_i$ [cm]	$I_i$ [cm <sup>4</sup> ]
Precast cross-section	2696.3	62.2	2560641	2856.7	61.1	2848818

**Internal forces from prestress (mean values, prestressed formwork state)**

Creep period	$N_{pm}^{(0)}$		$M_{pm}^{(0)}$		$\phi_{Fak}$ Prc
	tB [kN]	tE [kN]	tB [kNm]	tE [kNm]	
Storage	-1956.7	-1637.6	-792.33	-674.94	1.22
Utilization	-1717.0	-1160.2	-707.67	-549.27	1.00

tA=Begin, tE=End creep period  
 $\phi_{Fak}$ : Increase factor creep modulus (non-linear creep:> 1.0)

Prestress steel relaxation			
Lay. No.	Storage $\Delta\sigma_{p,r1}$ [N/mm <sup>2</sup> ]	Utilization $\Delta\sigma_{p,r2}$ [N/mm <sup>2</sup> ]	
1	-0.08	-8.50	
2	-0.08	-8.68	
3	-0.09	-8.87	
4	-0.09	-9.06	
5	-0.09	-9.25	
6	-0.09	-9.45	
7	-0.09	-9.65	
8	-0.10	-9.85	

Prestr. steel, losses due to creeping, shrinking and relaxation:			
Lay. No.	Storage $\Delta\sigma_{p,csr1}^{(0)}$ [N/mm <sup>2</sup> ]	Utilization $\Delta\sigma_{p,csr2}^{(0)}$ [N/mm <sup>2</sup> ]	
1	-93.48	-163.58	
2	-90.24	-160.74	
3	-86.99	-157.90	
4	-83.75	-155.07	
5	-80.51	-152.23	
6	-77.27	-149.40	
7	-74.03	-146.57	
8	-70.79	-143.74	

Stress in rebars due to creeping,shrinking and relaxation:			
Lay. No.	Storage $\Delta\sigma_{s,csr1}^{(0)}$ [N/mm <sup>2</sup> ]	Utilization $\Delta\sigma_{s,csr2}^{(0)}$ [N/mm <sup>2</sup> ]	
1	-100.10	-164.76	
2	-28.24	-98.51	
3	-18.44	-89.47	

**Bending with Normal Force ULS**

L.	Creep period	Cross-section	Tens-zone	z [cm]	$M_{Rd}$ [kNm]	$M_{Ed}$ [kNm]	$\eta$ (>1.0)	
1	tB Storage	P	top	70.5	339.08	$M_{Ed} < 0$	n/a	#1
2	tE Storage	P	bottom	74.4	2207.63	162.93	13.55	
3	tB Storage/Erection	P	top	70.5	339.08	5.87	57.79	#1
4	tE Storage/Erection	P	bottom	74.4	2207.63	$M_{Ed} < 0$	n/a	
5	tB Utilization	P	top	75.1	496.04	$M_{Ed} < 0$	n/a	
6	tE Utilization	P	bottom	74.3	2193.79	446.42	4.91	

#1:  $f_{ck}(t) = 0.73 * f_{ck}$



Interim results : Ultimate elongation and internal forces										
L.	$\epsilon_c$ [‰]	$\epsilon_s$ [‰]	x [cm]	$A_p$ [cm <sup>2</sup> ]	$A_s$ [cm <sup>2</sup> ]	$Z_p$ [kN]	$Z_s$ [kN]	Dc [kN]	Dp [kN]	Ds [kN]
1	3.500	2.500	56.5	0.0	12.6	0.0	500.3	1794.5	-1443.3	166.9
2	3.500	13.900	19.5	20.5	4.0	2828.8	178.1	2654.0	0.0	365.7
3	3.500	2.500	56.5	0.0	12.6	0.0	500.3	1794.5	-1443.3	166.9
4	3.500	13.900	19.5	20.5	4.0	2828.8	178.1	2654.0	0.0	365.7
5	3.500	4.900	40.4	0.0	12.6	0.0	548.3	1759.4	-1403.1	163.9
6	3.500	14.700	18.7	20.5	4.0	2828.0	178.2	2551.6	0.0	419.9

**Shear Resistance**

Design value shear force						
L.	Creep period	Combination	$V_{Ed,0}$ [kN]	$M_{Ed}$ [kNm]	dV [kN]	due to
1	tB Storage	QMax	158.5	162.91	-10.8	Vccd
2	tE Storage	QMax	158.5	162.91	-10.8	Vccd
3	tB Storage/Erection	QMax	-10.3	-5.87	0.0	-----
4	tE Storage/Erection	QMax	-10.3	-5.87	0.0	-----
5	tB Utilization	QMax	432.1	446.40	-29.8	Vccd
6	tE Utilization	QMax	432.1	446.40	-29.8	Vccd

Effective cross-section									
L.	Cross-section	Tens-zone	$b_w$ [cm]	d [cm]	z [cm]	$A_c$ [cm <sup>2</sup> ]	$A_{sl}$ [cm <sup>2</sup> ]	$\sigma_{cp}$ [N/mm <sup>2</sup> ]	$V_{Rdc}$ [kN]
1	P	bottom	19.0	97.1	74.4	2696.3	24.5	4.86	251.6
2	P	bottom	19.0	97.1	74.4	2696.3	24.5	5.47	281.6
3	P	top	19.0	91.3	70.5	2696.3	12.6	4.86	217.3
4	P	top	19.0	91.3	70.5	2696.3	12.6	5.47	243.3
5	P	bottom	19.0	97.1	74.3	2696.3	24.5	5.73	288.9
6	P	bottom	19.0	97.1	74.3	2696.3	24.5	3.87	237.5

Shear design $v_1 = 0.480$									
L.	$V_{Ed}$ [kN]	$V_{Ed,red}$ [kN]	$a_{cw}$	cot $\theta$	$a_{sw}$ [cm <sup>2</sup> /m]	Note	$a_l$ [cm]	$V_{Rd,max}$ [kN]	
1	147.7	147.7	1.250	2.487	1.83	Min	92.6	761.6	#1
2	147.7	147.7	1.164	2.123	2.15	Min	79.0	1015.3	
3	10.3	10.3	1.250	1.000	1.83	Min	45.6	1042.2	#1
4	10.3	10.3	1.164	1.000	2.15	Min	45.6	1247.5	
5	402.4	402.4	1.172	2.500	4.98	Var	92.8	912.3	
6	402.4	402.4	1.116	2.500	4.98	Var	92.8	868.9	

#1:  $f_{ck}(t) = 0.73 * f_{ck}$

**Check of crack width limit in SLS**

perm. crack width:  $w_k < 0$  mm, Frequent load combination

L.	Creep period	Cross-section	Tens-zone	$r_{sup}$ $r_{inf}$	$\max. \sigma_s$ [N/mm <sup>2</sup> ]	$s_{r,max}$ [mm]	$\epsilon_{sm} - \epsilon_{cm}$ [‰]	$w_k$ [mm]
1	tB Storage	P	top	1.00	no cracks			
2	tE Storage	P	bottom	1.00	CS completely compressed			
3	tB Storage/Erection	P	top	1.00	56.16	431	0.168	0
4	tE Storage/Erection	P	bottom	1.00	CS completely compressed			
5	tB Utilization	P	top	1.00	CS completely compressed			
6	tE Utilization	P	bottom	1.00	CS completely compressed			



Internal forces and elongation								
L.	N <sub>ges</sub> [kN]	M <sub>ges</sub> [kNm]	State I			State II		
			max. σ [N/mm <sup>2</sup> ]	X0I [cm]	φ <sub>eff</sub>	ε <sub>c</sub> [‰]	X0II [cm]	
1	-1956.7	-671.66	2.49	90.1	0.00	-0.718	69.6	
2	-1637.6	-554.27	-17.62	90.5				
3	-1956.7	-796.68	4.23	85.6				
4	-1637.6	-679.29	-20.30	85.1				
5	-1717.0	-430.40	-0.03	100.9				
6	-1160.2	-259.53	-9.63	105.7				

X0I: Pressure zone height in state I X0II: Pressure zone height in state II

L.	h <sub>c,ef</sub> [cm]	A <sub>ceff</sub> [cm <sup>2</sup> ]	ξ <sub>1</sub>	A <sub>p</sub> [cm <sup>2</sup> ]	A <sub>s</sub> [cm <sup>2</sup> ]	ρ <sub>p,ef</sub> [%]	ρ <sub>tot</sub> [%]	k1	k2	k3	c [cm]	k4
3	10.4	621.0	1.29	0.0	6.3	1.012	1.012	0.80	0.50	3.40	2.8	0.425

Internal forces cracking and strains (state II)								
L.	N <sub>ges</sub> [kN]	M <sub>ges</sub> [kNm]	State I			State II		
			max. σ [N/mm <sup>2</sup> ]	X0I [cm]	φ <sub>eff</sub>	ε <sub>c</sub> [‰]	X0II [cm]	
3	-1956.7	-785.48	4.07	85.9				

X0I: Pressure zone height in state I X0II: Pressure zone height in state II

**Minimum reinforcement for crack control:**

L.	Creep period	Cross-section	Tens-zone	r <sub>sup</sub> r <sub>inf</sub>	σ <sub>t</sub> [N/mm <sup>2</sup> ]	req. A <sub>s</sub> [cm <sup>2</sup> ]	exist. A <sub>s</sub> [cm <sup>2</sup> ]
1	tB Storage	P	top	1.00	3.61	< 4.07	not req.
2	tE Storage	P	bottom	1.00	-17.62	< 4.07	not req.
3	tB Storage/Erection	P	top	1.00	5.34	<= 0 cm <sup>2</sup>	
4	tE Storage/Erection	P	bottom	1.00	-20.30	< 4.07	not req.
5	tB Utilization	P	top	1.00	1.92	< 4.07	not req.
6	tE Utilization	P	bottom	1.00	-8.46	< 4.07	not req.

L.	D [mm]	x0IZ [cm]	A <sub>p</sub> [cm <sup>2</sup> ]	ξ <sub>1</sub>	Web				Flange			
					k	k <sub>c</sub>	A <sub>ct</sub> [cm <sup>2</sup> ]	A <sub>s</sub> [cm <sup>2</sup> ]	k	k <sub>c</sub>	A <sub>ct</sub> [cm <sup>2</sup> ]	A <sub>s</sub> [cm <sup>2</sup> ]
3	20	14.8	0.0	0.00	0.65	0.00	280.6	-nan(ind)	0.97	0.53	498.5	4.8

x0IZ: tensile zone in state I due to cracking forces

**Ductility reinforcement in precompressed tensile zone:**

b [cm <sup>3</sup> ]	f <sub>ctm</sub> [N/mm <sup>2</sup> ]	Z <sub>s</sub> [cm]	req. A <sub>s</sub> [cm <sup>2</sup> ]	exist. A <sub>s</sub> [cm <sup>2</sup> ]
19	4.07	97.1	3.9	4.0

**Stress checks SLS**

Concrete edge stresses in state I due to prestress, creep, shrinkage and relaxation				
L.	due to	σ <sub>R</sub> Precast		
		top [N/mm <sup>2</sup> ]	bottom [N/mm <sup>2</sup> ]	
1	Prestr. release anchorage	4.17	-23.84	
2	csr storage	-0.34	2.65	
3	csr utilisation	-0.08	4.58	



Tab. Compr stresses of concrete						
L.	Creep period	Cross-section	M <sub>Ed</sub> + = Max - = Min	σ <sub>c</sub> Precast		
				C <sub>c</sub> ,P <sub>k</sub> [N/mm <sup>2</sup> ]	Q <sub>c</sub> ,P <sub>k</sub> [N/mm <sup>2</sup> ]	
1	tB Storage	P	--	-21.25	-21.25	#1
2	tE Storage	P	--	-18.60	-18.60	
3	tB Storage/Erection	P	--	-26.55*		
4	tE Storage/Erection	P	--	-19.98		
5	tB Utilization	P	--	-15.24	-15.24	
6	tE Utilization	P	--	-10.66	-10.66	

#1: due to σ<sub>c</sub> > 0.45\* f<sub>ck</sub>(t) increased ceep modulus

Tab. Steel- and Concrete tension stress						
L.	Creep period	Cross-section	M <sub>Ed</sub> + = Max - = Min	σ <sub>p</sub>	σ <sub>s</sub>	σ <sub>t</sub>
				C <sub>c</sub> ,P <sub>m</sub> [N/mm <sup>2</sup> ]	C <sub>c</sub> ,P <sub>k</sub> [N/mm <sup>2</sup> ]	C <sub>c</sub> ,P <sub>k</sub> [N/mm <sup>2</sup> ]
1	tB Storage	P	---	887.99	8.61	2.49
2	tE Storage	P	+--	781.46	< 0	2.15
3	tB Storage/Erection	P	---	900.14	56.16	ZII
4	tE Storage/Erection	P	---	764.91	48.15	ZII
5	tB Utilization	P	++	836.43	< 0	ZII
6	tE Utilization	P	++	664.02	< 0	ZII

P<sub>k</sub>= Prestres char. value, P<sub>m</sub>= prestress mean value, StII: State II

**Selected section x = 3.60 m from left support**

Internal force combinations from external loading  
 LAC: dominant variable action (leading action)  
 ULS-PT : permanent + transient design situation (fundam. combination)  
 SLS-Cc : characteristic combination  
 SLS-Fc : frequent combination  
 SLS-Qc : quasi-permanent combination

**maximum moment : [kNm]**

	ULS-PT	SLS-Cc	SLS-Fc	SLS-Qc
Storage	543.37	402.48	402.48	402.48
Storage/Erection	-47.60	-47.60	-47.60	-47.60
Utilization	1471.73	1134.52	956.56	915.69
LAc	10	10	10	-

**Minimum moment : [kNm]**

	ULS-PT	SLS-Cc	SLS-Fc	SLS-Qc
Storage	402.45	402.48	402.48	402.48
Storage/Erection	-64.26	-47.60	-47.60	-47.60
Utilization	915.67	915.69	915.69	915.69
LAc	-	-	-	-

**maximum shear force:[kN]**

	ULS-PT
Storage	133.8
Storage/Erection	134.5
Utilization	356.2
LAc	10

**Effective Tendons ( prestressed formwork state for t = t0 (sto))**

Layer No.	No.	Area A <sub>p</sub> [cm <sup>2</sup> ]	Distance f.bottom [cm]	Prestress		tens.force		Shorttime Relaxation [N/mm <sup>2</sup> ]
				max [N/mm <sup>2</sup> ]	min [N/mm <sup>2</sup> ]	max [kN]	min [kN]	
1	3	2.8	8.5	956.37	956.37	266.8	266.8	-4.63
2	3	2.8	12.3	956.37	956.37	266.8	266.8	-4.63
3	3	2.8	16.1	956.37	956.37	266.8	266.8	-4.63
4	3	2.8	19.9	956.37	956.37	266.8	266.8	-4.63
5	3	2.8	23.7	956.37	956.37	266.8	266.8	-4.63



Layer No.	No.	Area Ap [cm <sup>2</sup> ]	Distance f.bottom [cm]	Prestress		tens.force		Shorttime Relaxation [N/mm <sup>2</sup> ]
				max [N/mm <sup>2</sup> ]	min [N/mm <sup>2</sup> ]	max [kN]	min [kN]	
6	3	2.8	27.5	956.37	956.37	266.8	266.8	-4.63
7	3	2.8	31.3	956.37	956.37	266.8	266.8	-4.63
8	1	0.9	35.1	956.37	956.37	88.9	88.9	-4.63

$\Delta\sigma(Tt0) = -39 \text{ N/mm}^2$  due to heat treatment

**Untensioned reinforcement**

Layer	Number	Diameter [mm]	Area [cm <sup>2</sup> ]	LE [cm]
1	2	16	4.0	3.6
2	2	20	6.3	98.6
3	2	20	6.3	109.8

**Cross-section Precast :**

Layer of cross-section from top to bottom				
Nr	Width [cm]	Distance [cm]	Remarks	
1	60.0	0.0		
2	60.0	15.0		
3	19.0	23.2	Web begin	
4	19.0	113.6	Web end	

**Cross-section Values**

	brutto			ideal		
	A <sub>c</sub> [cm <sup>2</sup> ]	z <sub>u</sub> [cm]	I <sub>c</sub> [cm <sup>4</sup> ]	A <sub>i</sub> [cm <sup>2</sup> ]	z <sub>i</sub> [cm]	I <sub>i</sub> [cm <sup>4</sup> ]
Precast cross-section	2940.8	69.3	3618822	3101.3	68.2	4006279

**Internal forces from prestress (mean values, prestressed formwork state)**

Creep period	N <sub>pm</sub> <sup>(0)</sup>		M <sub>pm</sub> <sup>(0)</sup>	
	tB [kN]	tE [kN]	tB [kNm]	tE [kNm]
Storage	-1956.7	-1763.7	-931.47	-864.86
Utilization	-1763.7	-1327.8	-864.86	-779.14

tA=Begin, tE=End creep period

Prestress steel relaxation		
Lay. No.	Storage $\Delta\sigma_{p,r1}$ [N/mm <sup>2</sup> ]	Utilization $\Delta\sigma_{p,r2}$ [N/mm <sup>2</sup> ]
1	-0.09	-10.88
2	-0.09	-10.92
3	-0.09	-10.97
4	-0.10	-11.01
5	-0.10	-11.06
6	-0.10	-11.11
7	-0.10	-11.15
8	-0.10	-11.20

Prestr. steel, losses due to creeping, shrinking and relaxation:		
Lay. No.	Storage $\Delta\sigma_{p,csr1}^{(0)}$ [N/mm <sup>2</sup> ]	Utilization $\Delta\sigma_{p,csr2}^{(0)}$ [N/mm <sup>2</sup> ]
1	-67.25	-114.61
2	-65.72	-115.19
3	-64.19	-115.77
4	-62.66	-116.36
5	-61.13	-116.94
6	-59.60	-117.52



Prestr. steel, losses due to creeping, shrinking and relaxation:			
Lay. No.	Storage $\Delta\sigma_{p,csr1}^{(0)}$ [N/mm <sup>2</sup> ]	Utilization $\Delta\sigma_{p,csr2}^{(0)}$ [N/mm <sup>2</sup> ]	
7	-58.07	-118.11	
8	-56.54	-118.69	

Stress in rebars due to creeping,shrinking and relaxation:			
Lay. No.	Storage $\Delta\sigma_{s,csr1}^{(0)}$ [N/mm <sup>2</sup> ]	Utilization $\Delta\sigma_{s,csr2}^{(0)}$ [N/mm <sup>2</sup> ]	
1	-70.93	-107.90	
2	-31.67	-121.91	
3	-27.04	-123.56	

**Bending with Normal Force ULS**

L.	Creep period	Cross-section	Tens-zone	z [cm]	M <sub>Rd</sub> [kNm]	M <sub>Ed</sub> [kNm]	η (>1.0)	
1	tB Storage	P	top	82.3	426.83	M <sub>Ed</sub> < 0	n/a	#1
2	tE Storage	P	bottom	87.4	2610.30	543.37	4.80	
3	tB Storage/Erection	P	top	82.3	426.83	64.26	6.64	#1
4	tE Storage/Erection	P	bottom	87.4	2610.30	M <sub>Ed</sub> < 0	n/a	
5	tE Utilization	P	top	89.0	588.56	M <sub>Ed</sub> < 0	n/a	
6	tE Utilization	P	bottom	86.9	2637.16	1471.73	1.79	

#1: fck(t)= 0.73 \* fck

Interim results : Ultimate elongation and internal forces										
L.	ε <sub>c</sub> [‰]	ε <sub>s</sub> [‰]	x [cm]	A <sub>p</sub> [cm <sup>2</sup> ]	A <sub>s</sub> [cm <sup>2</sup> ]	Z <sub>p</sub> [kN]	Z <sub>s</sub> [kN]	D <sub>c</sub> [kN]	D <sub>p</sub> [kN]	D <sub>s</sub> [kN]
1	3.500	3.100	58.2	0.0	12.6	0.0	546.9	1848.1	-1436.5	166.9
2	3.500	16.300	19.4	20.5	4.0	2871.2	178.9	2643.2	0.0	366.7
3	3.500	3.100	58.2	0.0	12.6	0.0	546.9	1848.1	-1436.5	166.9
4	3.500	16.300	19.4	20.5	4.0	2871.2	178.9	2643.2	0.0	366.7
5	3.500	6.700	37.7	0.0	12.6	0.0	549.4	1641.4	-1223.8	164.0
6	3.500	16.300	19.4	20.5	4.0	2862.7	178.7	2643.2	0.0	451.2

**Shear Resistance**

Design value shear force							
L.	Creep period	Combination	V <sub>Ed,0</sub> [kN]	M <sub>Ed</sub> [kNm]	dV [kN]	due to	
1	tB Storage	QMax	133.8	543.35	-30.8	V <sub>ccd</sub>	
2	tE Storage	QMax	133.8	543.35	-30.8	V <sub>ccd</sub>	
3	tB Storage/Erection	QMax	134.5	-64.26	0.0	-----	
4	tE Storage/Erection	QMax	134.5	-64.26	0.0	-----	
5	tB Utilization	QMax	356.2	1471.72	-83.8	V <sub>ccd</sub>	
6	tE Utilization	QMax	356.2	1471.72	-83.8	V <sub>ccd</sub>	

Effective cross-section									
L.	Cross-section	Tens-zone	b <sub>w</sub> [cm]	d [cm]	z [cm]	A <sub>c</sub> [cm <sup>2</sup> ]	A <sub>sI</sub> [cm <sup>2</sup> ]	σ <sub>cp</sub> [N/mm <sup>2</sup> ]	V <sub>Rdc</sub> [kN]
1	P	bottom	19.0	110.0	87.4	2940.8	24.5	4.86	277.2
2	P	bottom	19.0	110.0	87.4	2940.8	24.5	5.40	308.1
3	P	top	19.0	104.2	82.3	2940.8	12.6	4.86	241.5
4	P	top	19.0	104.2	82.3	2940.8	12.6	5.40	268.4
5	P	bottom	19.0	110.0	86.9	2940.8	24.5	5.40	308.1
6	P	bottom	19.0	110.0	86.9	2940.8	24.5	4.06	266.3



Shear design  $v_1 = 0.480$

L.	$V_{Ed}$ [kN]	$V_{Ed,red}$ [kN]	$a_{cw}$	$\cot \Theta$	$a_{sw}$ [cm <sup>2</sup> /m]	Note	$a_l$ [cm]	$V_{Rd,max}$ [kN]	
1	103.0	103.0	1.247	1.477	1.83	Min	64.6	1196.6	#1
2	103.0	103.0	1.162	1.261	2.15	Min	55.1	1503.5	
3	134.5	134.5	1.247	2.048	1.83	Min	84.3	956.9	#1
4	134.5	134.5	1.162	1.748	2.15	Min	72.0	1253.3	
5	272.4	272.4	1.162	3.353	2.15	Min	145.7	840.8	
6	272.4	272.4	1.122	2.500	2.88	Var	108.6	1022.2	

#1:  $f_{ck}(t) = 0.73 \cdot f_{ck}$

**Check of crack width limit in SLS**

perm. crack width:  $w_k < 0$  mm, Frequent load combination

L.	Creep period	Cross-section	Tens-zone	$r_{sup}$ $r_{inf}$	$\max. \sigma_s$ [N/mm <sup>2</sup> ]	$s_{r,max}$ [mm]	$\epsilon_{sm} - \epsilon_{cm}$ [‰]	$w_k$ [mm]
1	tB Storage	P	top	1.00	CS completely compressed			
2	tE Storage	P	bottom	1.00	CS completely compressed			
3	tB Storage/Erection	P	top	1.00	87.39	578	0.262	0
4	tE Storage/Erection	P	bottom	1.00	CS completely compressed			
5	tE Utilization	P	top	1.00	CS completely compressed			
6	tE Utilization	P	bottom	1.00	CS completely compressed			

Internal forces and elongation

L.	$N_{ges}$ [kN]	$M_{ges}$ [kNm]	State I			State II		
			$\max. \sigma$ [N/mm <sup>2</sup> ]	XOI [cm]	$\phi_{eff}$	$\epsilon_c$ [‰]	XOII [cm]	
1	-1956.7	-529.00	-0.32	116.0				
2	-1763.7	-462.38	-13.56	117.5				
3	-1956.7	-979.07	4.78	94.0	0.00	-0.738	68.9	
4	-1763.7	-912.46	-21.22	93.2				
5	-1327.8	136.55	-5.83	171.0				
6	-1327.8	177.42	-1.26	142.0				

XOI: Pressure zone height in state I XOII: Pressure zone height in state II

L.	$h_{c,ef}$ [cm]	$A_{ceff}$ [cm <sup>2</sup> ]	$\xi_1$	$A_p$ [cm <sup>2</sup> ]	$A_s$ [cm <sup>2</sup> ]	$\rho_{p,ef}$ [%]	$\rho_{tot}$ [%]	k1	k2	k3	c [cm]	k4
3	14.9	892.3	1.29	0.0	6.3	0.704	0.704	0.80	0.50	3.40	2.8	0.425

Internal forces cracking and strains (state II)

L.	$N_{ges}$ [kN]	$M_{ges}$ [kNm]	State I			State II		
			$\max. \sigma$ [N/mm <sup>2</sup> ]	XOI [cm]	$\phi_{eff}$	$\epsilon_c$ [‰]	XOII [cm]	
3	-1763.7	-861.70	4.07	94.6				

XOI: Pressure zone height in state I XOII: Pressure zone height in state II

**Minimum reinforcement for crack control:**

L.	Creep period	Cross-section	Tens-zone	$r_{sup}$ $r_{inf}$	$\sigma_t$ [N/mm <sup>2</sup> ]	req. $A_s$ [cm <sup>2</sup> ]	exist. $A_s$ [cm <sup>2</sup> ]
1	tB Storage	P	top	1.00	0.30	< 4.07	not req.
2	tE Storage	P	bottom	1.00	-13.56	< 4.07	not req.
3	tB Storage/Erection	P	top	1.00	4.65	<= 0 cm <sup>2</sup>	
4	tE Storage/Erection	P	bottom	1.00	-21.22	< 4.07	not req.
5	tE Utilization	P	top	1.00	-4.86	< 4.07	not req.
6	tE Utilization	P	bottom	1.00	1.77	< 4.07	not req.

L.	D [mm]	xOIZ [cm]	$A_p$ [cm <sup>2</sup> ]	$\xi_1$	Web				Flange			
					k	$k_c$	$A_{ct}$ [cm <sup>2</sup> ]	$A_s$ [cm <sup>2</sup> ]	k	$k_c$	$A_{ct}$ [cm <sup>2</sup> ]	$A_s$ [cm <sup>2</sup> ]
3	20	18.9	0.0	0.00	0.65	0.00	359.7	-nan(ind)	0.97	0.63	639.0	9.0

xOIZ: tensile zone in state I due to cracking forces





**Ductility reinforcement in precompressed tensile zone:**

b [cm <sup>3</sup> ]	f <sub>ctm</sub> [N/mm <sup>2</sup> ]	Z <sub>s</sub> [cm]	req. A <sub>s</sub> [cm <sup>2</sup> ]	exist. A <sub>s</sub> [cm <sup>2</sup> ]
19	4.07	110.0	4.4	4.0

**Stress checks SLS**

Concrete edge stresses in state I due to prestress, creep, shrinkage and relaxation

L.	due to	σ <sub>R</sub> Precast	
		top [N/mm <sup>2</sup> ]	bottom [N/mm <sup>2</sup> ]
1	Prestr. release anchorage	4.24	-22.16
2	csr storage	-0.13	1.76
3	csr utilisation	0.43	2.86

Tab. Compr stresses of concrete

L.	Creep period	Cross-section	M <sub>Ed</sub> + = Max - = Min	σ <sub>c</sub> Precast	
				Cc,Pk [N/mm <sup>2</sup> ]	Qc,Pk [N/mm <sup>2</sup> ]
1	tB Storage	P	--	-15.31	-15.31
2	tE Storage	P	--	-13.56	-13.56
3	tB Storage/Erection	P	--	-27.31*	
4	tE Storage/Erection	P	--	-22.83	
5	tB Utilization	P	+-	-8.74	-6.26
6	tE Utilization	P	+-	-8.31	-5.83

Tab. Steel- and Concrete tension stress

L.	Creep period	Cross-section	M <sub>Ed</sub> + = Max - = Min	σ <sub>p</sub> Cc,Pm [N/mm <sup>2</sup> ]	σ <sub>s</sub> Cc,Pk [N/mm <sup>2</sup> ]	σ <sub>t</sub> Cc,Pk [N/mm <sup>2</sup> ]
2	tE Storage	P	+-	849.73	< 0	ZII
3	tB Storage/Erection	P	---	899.12	87.39	ZII
4	tE Storage/Erection	P	---	820.77	84.70	ZII
5	tB Utilization	P	++	881.60	< 0	ZII
6	tE Utilization	P	+++	779.85	< 0	1.77

Pk= Prestres char. value, Pm= prestress mean value, StII: State II

**Selected section x = 0.08 m from left support**

Internal force combinations from external loading

LAc: dominant variable action (leading action)

ULS-PT : permanent + transient design situation (fundam. combination)

SLS-Cc : characteristic combination

SLS-Fc : frequent combination

SLS-Qc : quasi-permanent combination

**maximum moment : [kNm]**

	ULS-PT	SLS-Cc	SLS-Fc	SLS-Qc
Storage	13.29	9.83	9.83	9.83
Storage/Erection	-0.17	-0.17	-0.17	-0.17
Utilization	36.70	28.27	23.78	22.75
LAc	10	10	10	-

**Minimum moment : [kNm]**

	ULS-PT	SLS-Cc	SLS-Fc	SLS-Qc
Storage	9.80	9.83	9.83	9.83
Storage/Erection	-0.23	-0.17	-0.17	-0.17
Utilization	22.73	22.75	22.75	22.75
LAc	-	-	-	-



**maximum shear force:[kN]**

	ULS-PT
Storage	166.7
Storage/Erection	-2.0
Utilization	458.5
LAc	10

**Effective Tendons ( prestressed formwork state for t = t0 (sto))**

Layer No.	No.	Area Ap [cm <sup>2</sup> ]	Distance f.bottom [cm]	Prestress		tens.force		Shorttime Relaxation [N/mm <sup>2</sup> ]
				max [N/mm <sup>2</sup> ]	min [N/mm <sup>2</sup> ]	max [kN]	min [kN]	
1	3	2.8	8.5	247.68	152.10	69.1	42.4	-0.05
2	3	2.8	12.3	247.68	152.10	69.1	42.4	-0.05
3	3	2.8	16.1	247.68	152.10	69.1	42.4	-0.05
4	3	2.8	19.9	247.68	152.10	69.1	42.4	-0.05
5	3	2.8	23.7	247.68	152.10	69.1	42.4	-0.05
6	3	2.8	27.5	247.68	152.10	69.1	42.4	-0.05
7	3	2.8	31.3	247.68	152.10	69.1	42.4	-0.05
8	1	0.9	35.1	247.68	152.10	23.0	14.1	-0.05

$\Delta\sigma(Tt0) = -39 \text{ N/mm}^2$  due to heat treatment

**Untensioned reinforcement**

Layer	Number	Diameter [mm]	Area [cm <sup>2</sup> ]	LE [cm]
1	2	16	4.0	3.6
2	2	20	6.3	81.1
3	2	20	6.3	92.3

**Cross-section Precast :**

Layer of cross-section from top to bottom				
Nr	Width [cm]	Distance [cm]	Remarks	
1	60.0	0.0		
2	60.0	15.0		
3	19.0	23.2	Web begin	
4	19.0	96.1	Web end	

**Cross-section Values**

	brutto			ideal		
	A <sub>c</sub> [cm <sup>2</sup> ]	z <sub>u</sub> [cm]	I <sub>c</sub> [cm <sup>4</sup> ]	A <sub>i</sub> [cm <sup>2</sup> ]	z <sub>i</sub> [cm]	I <sub>i</sub> [cm <sup>4</sup> ]
Precast cross-section	2609.7	59.6	2239971	2770.2	58.5	2496523

**Internal forces from prestress (mean values, prestressed formwork state)**

Creep period	N <sub>pm</sub> <sup>(0)</sup>		M <sub>pm</sub> <sup>(0)</sup>	
	tB [kN]	tE [kN]	tB [kNm]	tE [kNm]
Storage	-506.7	-240.7	-192.30	-101.51
Utilization	-391.9	-25.8	-165.30	-57.77

tA=Begin, tE=End creep period

Prestress steel relaxation		
Lay. No.	Storage $\Delta\sigma_{p,r1}$ [N/mm <sup>2</sup> ]	Utilization $\Delta\sigma_{p,r2}$ [N/mm <sup>2</sup> ]
1	-0.00	-0.50
2	-0.00	-0.51
3	-0.00	-0.52
4	-0.00	-0.53
5	-0.00	-0.53
6	-0.00	-0.54



Prestress steel relaxation			
Lay. No.		Storage $\Delta\sigma_{p,r1}$ [N/mm <sup>2</sup> ]	Utilization $\Delta\sigma_{p,r2}$ [N/mm <sup>2</sup> ]
7		-0.00	-0.55
8		-0.00	-0.55

Prestr. steel, losses due to creeping, shrinking and relaxation:			
Lay. No.		Storage $\Delta\sigma_{p,csr1}^{(0)}$ [N/mm <sup>2</sup> ]	Utilization $\Delta\sigma_{p,csr2}^{(0)}$ [N/mm <sup>2</sup> ]
1		-36.33	-102.24
2		-35.67	-101.24
3		-35.02	-100.25
4		-34.37	-99.25
5		-33.71	-98.26
6		-33.06	-97.26
7		-32.41	-96.27
8		-31.75	-95.27

Stress in rebars due to creeping,shrinking and relaxation:			
Lay. No.		Storage $\Delta\sigma_{s,csr1}^{(0)}$ [N/mm <sup>2</sup> ]	Utilization $\Delta\sigma_{s,csr2}^{(0)}$ [N/mm <sup>2</sup> ]
1		-38.12	-105.77
2		-24.44	-84.82
3		-22.46	-81.80

**Bending with Normal Force ULS**

L.	Creep period	Cross-section	Tens-zone	z [cm]	M <sub>Rd</sub> [kNm]	M <sub>Ed</sub> [kNm]	η (>1.0)	
1	tB Storage	P	top	66.6	504.73	M <sub>Ed</sub> < 0	n/a	#1
2	tE Storage	P	bottom	69.0	2032.94	13.29	152.91	
3	tB Storage/Erection	P	top	66.6	504.73	0.23	2170.79	#1
4	tE Storage/Erection	P	bottom	69.0	2032.94	M <sub>Ed</sub> < 0	n/a	
5	tB Utilization	P	top	60.7	542.47	M <sub>Ed</sub> < 0	n/a	
6	tE Utilization	P	bottom	69.1	2017.85	36.70	54.98	

#1: fck(t)= 0.73 \* fck

**Interim results : Ultimate elongation and internal forces**

L.	ε <sub>c</sub> [%o]	ε <sub>s</sub> [%o]	x [cm]	A <sub>p</sub> [cm <sup>2</sup> ]	A <sub>s</sub> [cm <sup>2</sup> ]	Z <sub>p</sub> [kN]	Z <sub>s</sub> [kN]	D <sub>c</sub> [kN]	D <sub>p</sub> [kN]	D <sub>s</sub> [kN]
1	3.500	10.300	23.4	9.3	12.6	338.5	553.0	743.6	-35.3	166.8
2	3.500	13.500	19.1	20.5	4.0	2769.6	178.1	2597.6	0.0	355.4
3	3.500	10.300	23.4	9.3	12.6	338.5	553.0	743.6	-35.3	166.8
4	3.500	13.500	19.1	20.5	4.0	2769.6	178.1	2597.6	0.0	355.4
5	3.500	12.500	20.2	9.3	12.6	433.0	554.8	880.3	-56.0	163.7
6	3.500	14.300	18.2	20.5	4.0	2772.7	178.2	2492.6	0.0	399.4

**Shear Resistance**

Design value shear force						
L.	Creep period	Combination	V <sub>Ed,0</sub> [kN]	M <sub>Ed</sub> [kNm]	dV [kN]	due to
1	tB Storage	QMax	166.7	13.27	-1.0	V <sub>ccd</sub>
2	tE Storage	QMax	166.7	13.27	-1.0	V <sub>ccd</sub>
3	tB Storage/Erection	QMax	-2.0	-0.23	0.0	-----
4	tE Storage/Erection	QMax	-2.0	-0.23	0.0	-----
5	tB Utilization	QMax	458.5	36.68	-2.6	V <sub>ccd</sub>
6	tE Utilization	QMax	458.5	36.68	-2.6	V <sub>ccd</sub>



Effective cross-section									
L.	Cross-section	Tens-zone	b <sub>w</sub> [cm]	d [cm]	z [cm]	A <sub>c</sub> [cm <sup>2</sup> ]	A <sub>sl</sub> [cm <sup>2</sup> ]	σ <sub>cp</sub> [N/mm <sup>2</sup> ]	V <sub>Rdc</sub> [kN]
1	P	bottom	19.0	92.5	69.0	2609.7	24.5	1.75	160.5
2	P	bottom	19.0	92.5	69.0	2609.7	24.5	0.83	149.0
3	P	top	19.0	86.7	66.6	2609.7	12.6	1.75	131.9
4	P	top	19.0	86.7	66.6	2609.7	12.6	0.83	119.0
5	P	bottom	19.0	92.5	69.1	2609.7	24.5	1.35	162.8
6	P	bottom	19.0	92.5	69.1	2609.7	24.5	0.09	129.5

Shear design v1= 0.480

Check VRd,s not requ., asw und cotΘ from the last construction phase

L.	V <sub>Ed</sub> [kN]	V <sub>Ed,red</sub> [kN]	a <sub>cw</sub>	cot Θ	asw [cm <sup>2</sup> /m]	Note	a <sub>l</sub> [cm]	V <sub>Rd,max</sub> [kN]	
1	165.8	165.8	1.072	2.500	2.21	Var	86.2	603.2	#1
2	165.8	165.8	1.025	2.500	2.21	Var	86.2	741.3	
3	2.0	2.0	1.072	1.000	1.83	Min	43.4	844.4	#1
4	2.0	2.0	1.025	1.000	2.15	Min	43.4	1037.7	
5	455.9	455.9	1.041	2.500	6.07	Var	86.4	753.7	
6	455.9	455.9	1.003	2.500	6.07	Var	86.4	726.3	

#1: fck(t)= 0.73 \* fck

**Check of crack width limit in SLS**

perm. crack width: wk < 0 mm, Frequent load combination

L.	Creep period	Cross-section	Tens-zone	r <sub>sup</sub> r <sub>inf</sub>	max. σ <sub>s</sub> [N/mm <sup>2</sup> ]	S <sub>r,max</sub> [mm]	E <sub>sm</sub> -E <sub>cm</sub> [%]	W <sub>k</sub> [mm]
1	tB Storage	P	top	1.00	no cracks			
2	tE Storage	P	bottom	1.00	CS completely compressed			
3	tB Storage/Erection	P	top	1.00	no cracks			
4	tE Storage/Erection	P	bottom	1.00	CS completely compressed			
5	tB Utilization	P	top	1.00	no cracks			
6	tE Utilization	P	bottom	1.00	CS completely compressed			

**Internal forces and elongation**

L.	N <sub>ges</sub> [kN]	M <sub>ges</sub> [kNm]	State I			State II		
			max. σ [N/mm <sup>2</sup> ]	XOI [cm]	φ <sub>eff</sub>	ε <sub>c</sub> [%]	XOII [cm]	
1	-506.7	-182.47	0.92	83.6				
2	-240.7	-91.68	-3.02	82.2				
3	-506.7	-192.47	1.07	82.3				
4	-240.7	-101.68	-3.25	79.9				
5	-391.9	-142.54	0.73	83.3				
6	-25.8	-33.99	-0.89	65.4				

XOI: Pressure zone height in state I XOII: Pressure zone height in state II

L.	h <sub>c,ef</sub> [cm]	A <sub>ceff</sub> [cm <sup>2</sup> ]	ξ <sub>1</sub>	A <sub>p</sub> [cm <sup>2</sup> ]	A <sub>s</sub> [cm <sup>2</sup> ]	ρ <sub>p,ef</sub> [%]	ρ <sub>tot</sub> [%]	k1	k2	k3	c [cm]	k4

**Internal forces cracking and strains (state II)**

L.	N <sub>ges</sub> [kN]	M <sub>ges</sub> [kNm]	State I			State II		
			max. σ [N/mm <sup>2</sup> ]	XOI [cm]	φ <sub>eff</sub>	ε <sub>c</sub> [%]	XOII [cm]	

XOI: Pressure zone height in state I XOII: Pressure zone height in state II

**Minimum reinforcement for crack control:**

L.	Creep period	Cross-section	Tens-zone	r <sub>sup</sub> r <sub>inf</sub>	σ <sub>t</sub> [N/mm <sup>2</sup> ]	req. A <sub>s</sub> [cm <sup>2</sup> ]	exist. A <sub>s</sub> [cm <sup>2</sup> ]
1	tB Storage	P	top	1.00	1.88	< 4.07	not req.
2	tE Storage	P	bottom	1.00	-3.02	< 4.07	not req.
3	tB Storage/Erection	P	top	1.00	2.03	< 4.07	not req.
4	tE Storage/Erection	P	bottom	1.00	-3.25	< 4.07	not req.
5	tB Utilization	P	top	1.00	2.05	< 4.07	not req.
6	tE Utilization	P	bottom	1.00	-0.78	< 4.07	not req.



L.	D [mm]	x0IZ [cm]	A <sub>p</sub> [cm <sup>2</sup> ]	ξ <sub>1</sub>	Web				Flange			
					k	k <sub>c</sub>	A <sub>ct</sub> [cm <sup>2</sup> ]	A <sub>s</sub> [cm <sup>2</sup> ]	k	k <sub>c</sub>	A <sub>ct</sub> [cm <sup>2</sup> ]	A <sub>s</sub> [cm <sup>2</sup> ]
x0IZ: tensile zone in state I due to cracking forces												

**Ductility reinforcement in precompressed tensile zone:**

b [cm <sup>3</sup> ]	f <sub>ctm</sub> [N/mm <sup>2</sup> ]	Z <sub>s</sub> [cm]	req. A <sub>s</sub> [cm <sup>2</sup> ]	exist. A <sub>s</sub> [cm <sup>2</sup> ]
19	4.07	92.5	3.7	4.0

**Stress checks SLS**

Concrete edge stresses in state I due to prestress, creep, shrinkage and relaxation			
L.	due to	σ <sub>R</sub> Precast	
		top [N/mm <sup>2</sup> ]	bottom [N/mm <sup>2</sup> ]
1	Prestr. release anchorage	1.07	-6.34
2	csr storage	0.01	1.05
3	csr utilisation	0.19	2.93

**Tab. Compr stresses of concrete**

L.	Creep period	Cross-section	M <sub>Ed</sub> + = Max - = Min	σ <sub>c</sub> Precast	
				C <sub>c,Pk</sub> [N/mm <sup>2</sup> ]	Q <sub>c,Pk</sub> [N/mm <sup>2</sup> ]
1	tB Storage	P	--	-6.11	-6.11
2	tE Storage	P	--	-5.06	-5.06
3	tB Storage/Erection	P	--	-6.34	
4	tE Storage/Erection	P	--	-5.29	
5	tB Utilization	P	--	-4.76	-4.76
6	tE Utilization	P	--	-1.82	-1.82

**Tab. Steel- and Concrete tension stress**

L.	Creep period	Cross-section	M <sub>Ed</sub> + = Max - = Min	σ <sub>p</sub>	σ <sub>s</sub>	σ <sub>t</sub>
				C <sub>c,Pm</sub> [N/mm <sup>2</sup> ]	C <sub>c,Pk</sub> [N/mm <sup>2</sup> ]	C <sub>c,Pk</sub> [N/mm <sup>2</sup> ]
1	tB Storage	P	---	229.01	3.47	0.92
2	tE Storage	P	-+-	105.20	< 0	0.93
3	tB Storage/Erection	P	---	228.51	4.20	1.07
4	tE Storage/Erection	P	-+-	104.70	< 0	1.08
5	tB Utilization	P	++-	201.69	< 0	0.73
6	tE Utilization	P	++-	21.02	< 0	0.92

Pk= Prestres char. value, Pm= prestress mean value, StII: State II

**Lateral buckling (Stiglat)**

Safety in installed state η = 1.69 < 2.00  
 Design buckling moment: M<sub>kipp</sub> = 4657.51 kNm  
 existing moment : M<sub>Ed</sub> = 2763.72 kNm without prestress  
 Combination of characteristic values

Interim values acc. to 'Beton- und Stahlbetonbau' 1985, H. 9,10,11

E <sub>cm</sub> = 37000 N/mm <sup>2</sup>	G <sub>cm</sub> = 14800 N/mm <sup>2</sup>	I <sub>t</sub> , I <sub>y</sub> averaged
I <sub>t</sub> = 208188 cm <sup>4</sup>	I <sub>y</sub> = 394505 cm <sup>4</sup>	acc.to Rafla
I <sub>x</sub> = 11379011 cm <sup>4</sup>	A <sub>k</sub> = 4664.5 MN <sup>2</sup> cm <sup>4</sup>	(I <sub>t</sub> 60% as C.II)
h <sub>c</sub> = 1.58 m	β <sub>1</sub> = 0.000	β <sub>2</sub> = 0.003
k <sub>1</sub> = 3.540	k <sub>2</sub> = 1.000	k <sub>3</sub> = 0.920
M <sub>k</sub> = 7415.48 kNm	W <sub>x0</sub> = 123859 cm <sup>3</sup>	x = 20.20 m
σ <sub>B</sub> = 52.87 N/mm <sup>2</sup>	σ <sub>T</sub> = 33.21 N/mm <sup>2</sup>	λ <sub>v</sub> = 83.1

(σ<sub>T</sub> acc. eq.62calculated !)

a potentially nessecary reinforcement for torsion is not determined in the program

**Lateral buckling check in erection state (acc. to Stiglat)**

Height of left attachment point about LE beam  
 left H<sub>mh</sub> = 114.0 cm right H<sub>mh</sub> = 114.0 cm



**Erection with lifting beam**

Lateral buckling safety  $\eta = 4.29 > 2.50$   
 Design buckling moment:  $M_{kipp} = 2343.70$  kNm  
 existing moment :  $M_{Ed} = 546.28$  kNm without prestress

Interim values acc. to 'Beton- und Stahlbetonbau' 1985, H. 9,10,11

$\beta_4 = 0.000$   $\delta = 0.000$   $\gamma = 1.000$   
 $f = 0.331$  m  $A_k = 4664.5$  MN<sup>2</sup>cm<sup>4</sup>  $p = 0.752$   
 $j(\alpha) = 0.095$   $\alpha = 1.478$   $q_{kl} = 47.76$  kN/m  
 $W_{xo} = 148769$  cm<sup>3</sup>  $M_k = 2700.05$  kNm  $x = 16.83$  m  
 $\sigma_B = 18.15$  N/mm<sup>2</sup>  $\sigma_T = 15.75$  N/mm<sup>2</sup>  $\lambda_v = 141.8$

**Anchorage by bond ( over the left bearing)**

$l_{pt2} = 1.20$  m Distance first bending crack  $l_r = 3.37$  m  
 $\eta_{p2} = 1.20$   $f_{bpd} = 2.28$  N/mm<sup>2</sup>

x [m]	Z <sub>p</sub> [kN]	Z <sub>s</sub> [kN]	T <sub>Ed</sub> [kN]	$\eta = (Z_p+Z_s)/T_{Ed}$	Util
0.15	395.3	178.1	664.5	0.86	1.16
0.20	523.2	178.1	691.7	1.01	0.99
0.40	1046.5	178.0	799.3	1.53	0.65
0.60	1569.7	178.0	901.1	1.94	0.52
0.80	2093.0	178.0	1007.5	2.25	0.44
1.00	2616.2	178.1	1101.6	2.54	0.39
1.20	2831.2	178.2	1185.0	2.54	0.39
1.40	2832.3	178.2	1268.4	2.37	0.42
1.60	2833.2	178.2	1351.7	2.23	0.45
1.80	2834.1	178.2	1435.1	2.10	0.48
2.00	2845.5	178.4	1518.5	1.99	0.50

Z<sub>p</sub>: resisting tensile force by the prestressed steel  
 Z<sub>s</sub>: resisting tensile force by the rebars  
 T<sub>Ed</sub>: tensile force to be anchored

No. Lay.	Dist.LE [cm]	XA [m]	$\sigma_p$ [N/mm <sup>2</sup> ]	Eq.	$l_{bpd}$ [m]	xk [m]	$\Sigma Z_p$ [kN]	$\Sigma Z_s$ [kN]	T <sub>Ed</sub> [kN]	add. As [cm <sup>2</sup> ]	
1	8.5	0.00	619.00	8.21	2.15						Anchorage range uncracked (PT)
2	12.3	0.00	629.03	8.21	2.14						Anchorage range uncracked (PT)
3	16.1	0.00	639.06	8.21	2.13						Anchorage range uncracked (PT)
4	19.9	0.00	649.09	8.21	2.12						Anchorage range uncracked (PT)
5	23.7	0.00	659.11	8.21	2.11						Anchorage range uncracked (PT)
6	27.5	0.00	669.13	8.21	2.10						Anchorage range uncracked (PT)
7	31.3	0.00	679.15	8.21	2.34						Anchorage range uncracked (PT)
8	35.1	0.00	689.17	8.21	2.33						Anchorage range uncracked (PT)

XA: Beginning of the anchoring area of the steel layer (dist. from the corresp. binder side)  
 Eq. 8.21.1: Anchorage area uncracked,  $\sigma_p$  acc.to fig. 8.17DE (b)  
 Eq. 8.21.1: Anchorage area cracked,  $\sigma_p$  acc.to fig. 8.17DE (b)  
 xk: decisive section in the anchoring area of the layer (distance from the beginning of the binder)  
 add. As: Additional sagging reinforcement required for anchorage

**Anchorage by bond ( over the right bearing)**

$l_{pt2} = 1.20$  m Distance first bending crack  $l_r = 3.37$  m  
 $\eta_{p2} = 1.20$   $f_{bpd} = 2.28$  N/mm<sup>2</sup>

x [m]	Z <sub>p</sub> [kN]	Z <sub>s</sub> [kN]	T <sub>Ed</sub> [kN]	$\eta = (Z_p+Z_s)/T_{Ed}$	Util
28.30	2845.5	178.4	1518.5	1.99	0.50
28.50	2834.1	178.2	1435.1	2.10	0.48
28.70	2833.2	178.2	1351.7	2.23	0.45
28.90	2832.3	178.2	1268.4	2.37	0.42
29.10	2831.2	178.2	1185.0	2.54	0.39
29.30	2616.2	178.1	1101.6	2.54	0.39
29.50	2093.0	178.0	1007.5	2.25	0.44
29.70	1569.7	178.0	901.1	1.94	0.52
29.90	1046.5	178.0	799.3	1.53	0.65



x [m]	Z <sub>p</sub> [kN]	Z <sub>s</sub> [kN]	T <sub>Ed</sub> [kN]	η= (Z <sub>p</sub> +Z <sub>s</sub> )/T <sub>Ed</sub>	Util
30.10	523.2	178.1	691.7	1.01	0.99
30.15	395.3	178.1	664.5	0.86	1.16

Z<sub>p</sub>: resisting tensile force by the prestressed steel  
Z<sub>s</sub>: resisting tensile force by the rebars  
T<sub>Ed</sub>: tensile force to be anchored

No. Lay.	Dist.LE [cm]	XA [m]	σ <sub>p</sub> [N/mm <sup>2</sup> ]	Eq.	l <sub>bpd</sub> [m]	xk [m]	ΣZ <sub>p</sub> [kN]	ΣZ <sub>s</sub> [kN]	T <sub>Ed</sub> [kN]	add. As [cm <sup>2</sup> ]	
1	8.5	0.00	619.00	8.21	2.15						Anchorage range uncracked (PT)
2	12.3	0.00	629.03	8.21	2.14						Anchorage range uncracked (PT)
3	16.1	0.00	639.06	8.21	2.13						Anchorage range uncracked (PT)
4	19.9	0.00	649.09	8.21	2.12						Anchorage range uncracked (PT)
5	23.7	0.00	659.11	8.21	2.11						Anchorage range uncracked (PT)
6	27.5	0.00	669.13	8.21	2.10						Anchorage range uncracked (PT)
7	31.3	0.00	679.15	8.21	2.34						Anchorage range uncracked (PT)
8	35.1	0.00	689.17	8.21	2.33						Anchorage range uncracked (PT)

XA: Beginning of the anchoring area of the steel layer (dist. from the corresp. binder side)  
Eq. 8.21.1: Anchorage area uncracked, σ<sub>p</sub> acc.to fig. 8.17DE (b)  
Eq. 8.21.1: Anchorage area cracked, σ<sub>p</sub> acc.to fig. 8.17DE (b)  
xk: decisive section in the anchoring area of the layer (distance from the beginning of the binder)  
add. As: Additional sagging reinforcement required for anchorage

**Bursting Reinforcement at beginning of beam**

$\gamma_{p,unfav} = 1.20$        $l_{disp} = 1.35$  m

No.	Initiation zone		Dist.LE [cm]	N <sub>c</sub> [kN]	N <sub>p</sub> [kN]	T <sub>p</sub> [kN]	Factor Interpolation	req. As [cm <sup>2</sup> ]
	from [m]	to [m]						
1	0.00	1.35	36.1	-1286.3	1762.0	475.8	0.406	5.3

The bursting reinforcement must be arranged in zone of reduced dispersion length.  
red. dispersion length indented wire w.o. strand 3/4\* $l_{disp}=1.02$  m

**Bursting Reinforcement at end of beam**

$\gamma_{p,unfav} = 1.20$        $l_{disp} = 1.35$  m

No.	Initiation zone		Dist.LE [cm]	N <sub>c</sub> [kN]	N <sub>p</sub> [kN]	T <sub>p</sub> [kN]	Factor Interpolation	req. As [cm <sup>2</sup> ]
	from [m]	to [m]						
1	30.30	28.95	36.1	-1286.3	1762.0	475.8	0.406	5.3

The bursting reinforcement must be arranged in zone of reduced dispersion length.  
red. dispersion length indented wire w.o. strand 3/4\* $l_{disp}=1.02$  m